

1                   **THE ARCHITECTURE OF GREEN ENERGY SYSTEMS\***

2                   MICHAEL C. FERRIS<sup>†</sup> AND ANDY PHILPOTT <sup>‡</sup>

3           **Abstract.** Energy production throughout the world is transitioning from fossil fuels to renewable  
4 sources such as wind power and solar power. This transition has been gradual - over half of the world's  
5 electricity is still produced by coal, oil and gas - but must accelerate to meet global emission targets.  
6 This paper examines the contributions that mathematical modeling can make to help accelerate this  
7 transition. The models we catalog are confined to optimization and equilibrium models, but cover  
8 a range of physical scales and time scales. Our focus is on novel model formulations that can help  
9 overcome the challenges of the transition by unpicking the complexity inherent in many settings and  
10 quantifying the tradeoffs that must be made when developing energy policy.

11           **Key words.** green energy transition, renewable electricity, carbon prices

12           **MSC codes.** 49-02, 65K10, 90C90, 91B74

13           **1. Introduction.** The world is undergoing a transition from using fossil-fuel  
14 energy that emits greenhouse gases (mainly carbon dioxide) to using energy that  
15 does not. This transition is a global response to calls to limit global warming that  
16 has been caused by the emission of greenhouse gases over the post-industrial era.  
17 The current scale and speed of this transition appears insufficient to keep global  
18 temperatures below agreed targets. There are many technical, economic, social and  
19 political reasons for this slowness that have been canvassed in a number of recent  
20 reports (see e.g., [1, 2, 7]).

21           Our purpose in this paper is to examine the contribution that mathematics and  
22 mathematical models can make to understanding and overcoming the barriers that  
23 are faced in the transition. Those barriers include affordability, reliability, industrial  
24 competitiveness, and trusted information. The contribution of the paper is primarily  
25 to present mathematics; it is not intended to be a survey of existing energy models,  
26 of which there are many (see, e.g., [55, 21]).

27           In particular we will focus on what we call the *architecture* of energy systems,  
28 which consists not only of the physical infrastructure for generating and transporting  
29 energy, but also the market and contractual arrangements that give incentives for  
30 investing in this infrastructure and that allow for it to be operated in an efficient  
31 manner. Our aim is not so much to deliver the correct answer or define an optimal  
32 solution, but rather to pose questions that can benefit from a mathematical modeling  
33 approach. Many of our approaches incorporate techniques to promote flexibility [15],  
34 including multiple types of dispatchable generation, demand response, energy storage  
35 and enhanced connectivity.

36           We are interested in the architecture of systems that generate mainly *green* energy,  
37 a catch-all term that encompasses renewable energy from sources that are constantly  
38 and naturally renewed such as hydroelectric power, wind power and solar power,  
39 and energy from other sources with negligible carbon emissions (such as nuclear and  
40 geothermal electricity), or net-zero emissions (such as biofuels). Such systems will be  
41 an essential part of the transition, along with new technologies that fill gaps in our

---

\*Submitted to the editors DATE.

**Funding:** This work was funded by MBIE, and the National Science Foundation.

<sup>†</sup>Computer Sciences Department and Wisconsin Institute for Discovery, University of Wisconsin, Madison, WI 53706 (ferris@cs.wisc.edu)

<sup>‡</sup>Electric Power Optimization Centre, University of Auckland, New Zealand (a.philpott@auckland.ac.nz).

42 operating landscape.

43 Our use of the adjective green in this context might be viewed by some as con-  
 44 tentious, as some activities associated with green energy production (such as building  
 45 hydroelectric dams or mining lithium) can damage the natural environment. As we  
 46 discuss later in the paper, some of this damage might be justifiable when traded off  
 47 against the damage avoided by reducing carbon emissions, so it would be unwise to  
 48 preclude such activities from the mix of green energy we study.

49 Designing the green energy system of the future is a global problem involving  
 50 interactions between countries across the world and requiring long term investments,  
 51 changes of operational procedures, trade-offs and innovations. While internationally  
 52 coordinated efforts are likely to be the most effective and economical, this is hampered  
 53 by political discord, disparate goals and perspectives on the severity of the issue, and  
 54 different ideas on the best course of action to transition into a green energy system.  
 55 Even within countries, different agents view the risk of inaction, or incorrect actions,  
 56 in contrasting ways, and will make decisions in their own interests in response to  
 57 incentives and regulations.

58 The challenge then lies mainly in designing appropriate incentives and regulations,  
 59 so agents with different attitudes to risk align their actions with the objective of global  
 60 emissions reduction. Our approach in this paper is to look at tools that capture the  
 61 risk in each agents problems, suggest models and approaches to invest in a portfolio  
 62 of technologies that may reduce the variability in outcomes and enhance the ability to  
 63 finance their adoption, whilst quantifying the differences between these agent-driven  
 64 results and one that might arise with a system-wide perspective.

65 A green energy system can be viewed along three orthogonal dimensions. We  
 66 show two of these in Figure 1.

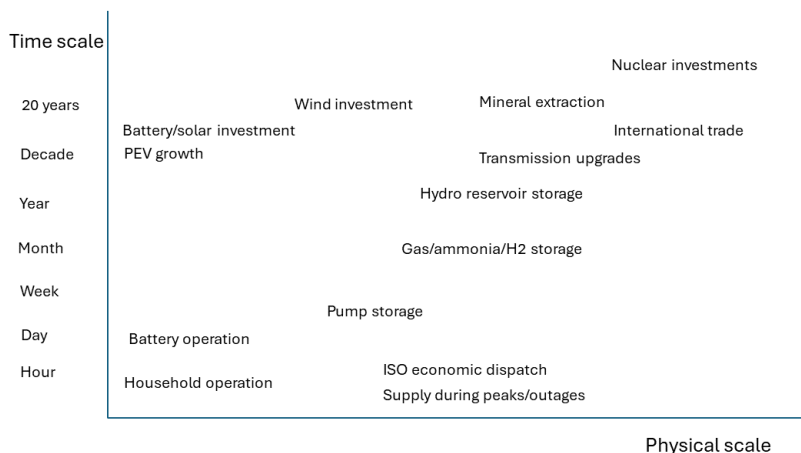


FIG. 1. *The energy transition in two dimensions*

67 In one dimension one can vary the physical scale of the system. At the smallest  
 68 scale, one might consider a household with solar panels, a battery and a plug-in elec-

69 tric vehicle. This could form part of a micro grid, which in turn connects to a larger  
70 system with industrial electricity supply and demand. High voltage electricity trans-  
71 mission lines link these together into an electricity network, that may be connected  
72 to neighbouring networks by transfers along tie lines. The system might transport  
73 energy from place to place using other carriers such as hydrogen, ammonia, natural  
74 gas, oil, coal or uranium. Transfers of energy are accompanied by financial flows,  
75 and derivative instruments that derive their value from these transactions. At the  
76 largest (global) scale the energy and financial flows are between different regions and  
77 economies; the design and operation of new forms of contracts and financial flows are  
78 critical to enabling the transition process.

79 The overall system is a collection of technologies at different physical scales, con-  
80 nected through a network that might be electrical or some other energy transport. To  
81 answer questions about the architecture of this system, or the design and operation  
82 of a component, one can consider a particular scale, in which case the interplay with  
83 larger (or smaller) scales needs to determine boundary interactions. Such boundary  
84 interactions may be physical, financial, regulatory or involve some form of incentives.

85 The second important dimension to consider is time, and implicitly the evolution  
86 of uncertainties over varying time scales. Energy is produced and consumed continu-  
87 ously, but questions about the architecture of energy systems are posed with different  
88 temporal resolution. Also, information flows are often uncertain, and are resolved at  
89 a variety of time scales. Predicting new technologies or policy changes, or the increase  
90 in electrical demand due to transitions in domestic heating or transport, or the in-  
91 stallation and closing of different generation plants can involve complex models and  
92 forecasts and these can evolve over time within a physical or computational learning  
93 process. Dealing with uncertainty in forecasts requires models of some sophistication.  
94 In the short term, the intermittency of solar and wind power requires backup sup-  
95 ply in the form of fast-start generation, load reduction or batteries, so that supply is  
96 reliable. On a longer time scale, energy might need to be stored (e.g., in a hydro reser-  
97 voir) for use in future months when the supply of other sources of energy are lower.  
98 The aforementioned issues relate to parametric uncertainties - things we know the  
99 form of but are unclear about their actual levels. In contrast, model (or structural)  
100 uncertainty arises in problems that involve long-lived capacity choices and need to  
101 account for many possible states of the world (e.g., emission constraints, technology  
102 changes, political environment) in future decades.

103 The third important dimension represents social and political or behavioral as-  
104 pects. These can involve interplay with other (political) institutions, agencies (coun-  
105 tries or adversaries) or policies and information. While we discuss models of behavior  
106 related to (mathematical) game theory, this paper does not address social/political  
107 factors or their evolution. Nonetheless, it is understood that interactions of these  
108 types can affect the efficiency of designed systems and how local or national behavior  
109 influences the outcomes of a given architecture.

110 The paper examines a number of policy questions arising in the green energy  
111 transition that can be viewed in the above three dimensions. Despite the enthusiasm of  
112 advocates for silver bullet solutions to the green-energy transition, the policy questions  
113 that arise are complex and do not admit simple intuitive solutions. Our interest in  
114 this paper is in formulating these questions in mathematical terms with a view to  
115 representing the complexity of the tradeoffs involved. Problem formats that model  
116 interactions, and determine what regimes are active at any given time are important  
117 in understanding overall structure of solutions, even if specific details are abstracted  
118 or approximated.

119 Our mathematical framework draws on two core methodologies: optimization  
 120 and game theory. Optimization is a powerful tool for exploring the tradeoffs that  
 121 are inevitable when comparing competing technologies. For example, it is tempting  
 122 to remove all fossil-fuelled electricity capacity from a region to make its electricity  
 123 100% renewable, but this might be very expensive compared with a system with 1%  
 124 of fossil-fuelled generation capacity that is used sparingly (see, e.g. [25]). System  
 125 optimization models make these tradeoffs explicit, and enable decision makers to  
 126 arrive at optimal combinations of technologies that will meet desired emission goals  
 127 at least cost. For models involving time and uncertainty, the optimization models  
 128 become more complicated, and must deal with estimates of probability distributions  
 129 and attitudes to risk.

130 The second methodology guiding our approach is game theory. The transition to  
 131 green energy emerging in most countries is driven by competing commercial agents,  
 132 responding to incentives and regulations set by governments. In its simplest form, this  
 133 setup is known by economists as a *principal-agent* problem [31], in which a leader takes  
 134 some action and a number of followers respond by optimizing their own objectives in  
 135 a competitive environment. There are many different versions of this simple game  
 136 model that arise from varying assumptions on the degree of strategic behavior of  
 137 agents and the knowledge that each agent has at their disposal. The models can  
 138 capture features such as barriers to entry, collaboration or contrasting risk attitudes.

139 In summary, the mathematical study of the architecture of green energy systems  
 140 involves suites of models encompassing different resolutions in each dimension. The  
 141 models can be optimized to determine some *social plan* of action that maximizes  
 142 overall welfare subject to constraints, e.g., on emissions. This gives a gold-standard  
 143 benchmark for more realistic policies that will attempt to achieve results through  
 144 incentives (e.g., carbon taxes) and regulations (e.g., renewable energy standards).  
 145 The extent to which the outcomes of these policies fall short of the gold-standard  
 146 benchmark can be evaluated by game-theory models.

147 The paper is laid out as follows. In the next section we classify in mathematical  
 148 terms the types of optimization and equilibrium models that will be applied to the  
 149 various settings we study. Section 3 then describes a collection of example problems  
 150 that can be studied using a selection of models cataloged in Section 2. Section 4 is  
 151 devoted to a discussion of risk, and how one might devise models that represent the  
 152 partial equilibrium that emerges when agents have contrasting risk measures. We  
 153 then make some concluding remarks in Section 5.

154 **2. Mathematical Models.** While there are many mathematical constructs that  
 155 could influence the choice of architecture, we will confine ourselves in this paper to  
 156 discussing approaches that are based in the field of optimization, and specifically to  
 157 approaches that utilize constraints to model the underlying physical nature of the  
 158 problems at hand. It is understood that any such model needs to be populated  
 159 with data that instantiates these mathematical relationships. Different data will be  
 160 relevant for models at disparate scales, but we will not cover the acquisition details  
 161 of this. Nevertheless, we will consider the uncertain nature of these data and suggest  
 162 models that account for this uncertainty using stochastic optimization approaches. In  
 163 this section, we briefly outline the main formats that we will use in the sequel.

164 **2.1. Optimization models.** Our models will consider decision variables  $x$  that  
 165 live in a finite dimensional space  $\mathbb{R}^n$ . These variables are constrained to lie in a subset  
 166  $X$  of  $\mathbb{R}^n$  and are used to define an objective function  $f$  that maps  $\mathbb{R}^n$  to the real line,  
 167 and a vector valued function  $g$  that is constrained to lie in some cone  $K$ , resulting in

168 the optimization problem

$$169 \quad (2.1) \quad \min_{x \in X} f(x) \text{ s.t. } g(x) \in K.$$

170 Special cases of the data of this problem lead to formats under consideration, namely:

- 171 1. if  $f$  is a linear function, and  $g$  is an affine function,  $X$  is polyhedral (possibly
- 172  $\mathbb{R}^n$ ) and  $K = \{0\}^p \times \mathbb{R}_-^m$ , then (2.1) is a linear program (LP)
- 173 2. if in addition  $X \subset \mathbb{Z}^{n_1} \times \mathbb{R}^{n_2}$  (i.e. some of the variables can only take on
- 174 discrete values), then (2.1) is a mixed integer program (MIP)
- 175 3.  $K$  can model both equations and inequalities or a mixture of both (as shown
- 176 item 1 above)
- 177 4. if  $f$  and  $g$  are convex functions of  $x$  then (2.1) is a convex optimization
- 178 problem
- 179 5. if  $\xi$  is a random variable defined on a probability space  $(\Omega, \mathcal{F}, \mathbb{P})$ , and  $f(x) =$
- 180  $c(x) + \mathbb{E}_{\mathbb{P}}[Q(x, \xi)]$  where  $Q(x, \xi)$  is the optimal value of the second-stage prob-
- 181 lem

$$182 \quad \min_y q(y, \xi) \text{ s.t. } T(\xi)x + Wy = h(\xi)$$

183 then (2.1) is a two-stage stochastic programming problem

- 184 6. if in addition  $X = \{x \geq 0 : Ax = b\}$ ,  $c(x) = c^T x$  and  $q(y, \xi) = q(\xi)^T y$ , then
- 185 the problem is a two stage stochastic linear programming problem.

186 The formulation of the above two-stage problem assumes that the second-stage  
187 data  $\xi$  is modeled as a random vector with a known probability distribution. In many  
188 applications the expectation  $\mathbb{E}$  can be replaced by a more general risk measure  $\rho$ .

189 The two-stage stochastic programming problem can be extended to a multistage  
190 stochastic programming problem, in which decisions are made in many stages  $t =$   
191  $1, 2, \dots, T$  and the random variables define a stochastic process  $\xi_t, t = 1, 2, \dots, T$ .  
192 After each stage  $t$  the values of  $\xi_t$  are realized, and adaptive decisions made in the  
193 light of this information. Such problems are useful in studying investment problems  
194 over long time horizons when new information might require existing capacity to be  
195 retired or replaced.

196 A useful special case of multistage stochastic programming is the discrete-time  
197 stochastic optimal control problem. Here the random variables  $\xi_t$  at each stage  $t$  are  
198 assumed to be independent of those at previous and later stages, and the decision  
199 variables divide into states  $x$  and controls  $u$ . This gives constraints:

$$200 \quad x_{t+1} = g_t(x_t, u_t, \xi_t), \quad u_t \in \mathcal{U}_t, \quad t = 1, 2, \dots, T - 1$$

201 and objective

$$202 \quad f(x) = \mathbb{E}\left[\sum_{t=1}^T f_t(x_t, u_t, \xi_t)\right].$$

203 In this case the problem has a finite horizon; infinite-horizon versions replace the sum  
204 in the objective with a discounted infinite series. Stochastic optimal control problems  
205 are amenable to solution by (approximate) dynamic programming [8, 58].

206 It is important here to be specific about the nature of the uncertainty in the  
207 above models. In most stochastic optimization problems, the random variables are  
208 assumed to have known distributions that can be estimated from a sample of historical

209 data. A popular approach is to solve a sample average approximation problem using  
 210 the finite empirical distribution [64]. Convergence of this approach with increasing  
 211 sample size relies on laws of large numbers and the central limit theorem, which  
 212 may not hold for heavy-tailed distributions. For stochastic optimization problems  
 213 involving planning decisions made many years in the future, probabilities (e.g., of a  
 214 new technology emerging) are impossible to estimate from historical data, and some  
 215 expert assessment must be made and tested. As identified by Mercure et al [50], risks  
 216 and opportunities in these settings are more important to identify than net present  
 217 values based on discounted expected cash flow. A real-options [13] approach has some  
 218 appeal here though this is difficult to apply in system settings where there are many  
 219 competing and complementary investment options, and limited hedging instruments.  
 220 An alternative approach is outlined in [62].

221 Risk-averse stochastic programming problems formulated in scenario trees provide  
 222 another alternative framework that models upside optionality as well as downside risk.  
 223 Binary variables in these models can represent timing decisions, e.g. when to build  
 224 or shut down generating plants, albeit with an increase in computational complexity.  
 225 It is important to recognize that these models are *look-ahead* optimization models  
 226 [57], with the goal of specifying a well-hedged first-stage decision. The intention  
 227 after the first stage decision is implemented, is to re-solve a new model in a rolling-  
 228 horizon fashion with updated estimates of parameters. How far to look ahead, how to  
 229 appropriately approximate the future, and how to implement the solutions in practice  
 230 are all interesting research questions, with answers that can generally only be settled  
 231 by numerical experiments with context-specific models.

232 Finally in some settings one might seek a solution that performs well over a set  
 233 of varying problem data. *Robust optimization* provides a numerically efficient way of  
 234 doing this by specifying a convex uncertainty set  $\mathcal{U}$  that defines the data variations  
 235 (see [9]). For example, when the constraint data are uncertain we obtain:

$$236 \quad (2.2) \quad \min f(x) \text{ s.t. } x \in X(u), \quad u \in \mathcal{U}.$$

237 This notion can be extended to compute a *distributionally robust* solution to a sto-  
 238 chastic optimization problem that performs well for every probability distribution  
 239 lying in a set  $\mathcal{P}$ . An example formulation would be as follows.

$$240 \quad (2.3) \quad \min_{x \in X} \max_{\mathbb{P} \in \mathcal{P}} \mathbb{E}_{\mathbb{P}}[f(x, \xi)].$$

241 **2.2. Complementarity models.** A complementarity problem is a generaliza-  
 242 tion of the optimality conditions of (2.1). In this setting we seek a variable  $x$  such  
 243 that

$$244 \quad x \in X, F(x) \in X^*, x^T F(x) = 0$$

245 where  $F : \mathbb{R}^n \mapsto \mathbb{R}^n$ ,  $X$  is now a cone (in many settings the positive orthant in  
 246  $\mathbb{R}^n$ ) and  $X^*$  is the dual cone  $X^* := \{w : z^T w \geq 0, \forall z \in X\}$ . The third constraint  
 247 indicates that  $x$  and  $w = F(x)$  form a complementary pair and is often written as  
 248  $x \perp w$ . The complementary slackness conditions of linear programming are a special  
 249 case of a complementarity problem. While there are many examples of the use of  
 250 complementarity formulations in engineering and economics (see [24, 27]), one par-  
 251 ticular modeling use allows the formulation to automatically switch between regimes  
 252 of operation. For example, in [16] complementarity constraints are used to model

253 automatic tap-changing transformers and other switched electrical devices. Given the  
254 following constraints,

$$\begin{aligned}
 255 \quad & v = \bar{v} + v^+ - v^-, \\
 256 \quad & 0 \leq (q - q^{min}) \perp v^+ \geq 0, \\
 257 \quad & 0 \leq (q^{max} - q) \perp v^- \geq 0,
 \end{aligned}$$

259 it is easy to see that  $v$  is at set point  $\bar{v}$  when  $q$  is strictly between  $q^{min}$  and  $q^{max}$ ,  
260 whereas if  $q$  is at one of its bounds, then  $v$  is allowed to move away from the set point  
261 value.

262 A generalization of the complementarity problem is a variational inequality, where

$$263 \quad x \in X \text{ and } F(x)^T(z - x) \geq 0, \text{ for all } z \in X.$$

264 This is sometimes termed a generalized equation, since in the special case of  $X = \mathbb{R}^n$   
265 it simplifies to the solution of a square nonlinear system  $F(x) = 0$ . It is also clear that  
266 when  $X$  is a cone, this is identical to the (cone) complementarity problem. When  $X$   
267 is a convex set (not necessarily a cone), then the optimality conditions of

$$268 \quad \min_{x \in X} f(x)$$

269 are in the form of a variational inequality:

$$270 \quad x \in X \text{ and } \nabla f(x)^T(z - x) \geq 0, \forall z \in X,$$

271 which are necessary and sufficient for optimality under a convexity assumption. For  
272 the optimality conditions of (2.1), where the constraints  $g(x) \in K$  have a particular  
273 representation, Lagrange multipliers can be introduced and the variational inequality  
274 are the so-called KKT-conditions. In this setting, a constraint qualification may be  
275 needed to prove equivalence to the optimization. The motivation to call this problem  
276 format an equilibrium problem arises from the consideration of the variational form of  
277 the Signorini problem [24]. Specialized techniques for solution are given in [45], for  
278 example.

279 A bilevel program is an example of a hierarchical optimization where a paramet-  
280 ric version of (2.1), the so-called lower level (follower) problem, is embedded in the  
281 constraint set of an upper level (leader) case of (2.1). Formally,

$$282 \quad (2.4) \quad \min_{(x,y) \in X} f_U(x, y) \text{ s.t. } g_U(x, y) \in K_U, y \in \text{SOL}_L(x)$$

283 where

$$284 \quad \text{SOL}_L(x) := \arg \min_{z \in Y} f_L(x, z) \text{ s.t. } g_L(x, z) \in K_L.$$

285 In other settings,  $\text{SOL}_L$  might consist of the optimal solutions of several linked  
286 optimization problems as in a non-cooperative game. Here the lower level problem  
287  $y \in \text{SOL}_L(x)$  can be replaced by a set valued inclusion  $(x, y) \in \text{SOL}_L$  that represents  
288 a more general parametric equilibrium:

$$289 \quad (2.5) \quad \min_{(x,y) \in X} f_U(x, y) \text{ s.t. } g_U(x, y) \in K_U, (x, y) \in \text{SOL}_L$$

290 For example, there may be many followers  $f_L(i)$ ,  $i \in I$ , where given the leader's  
 291 policy choice  $x$ , the followers' actions are assumed to be chosen to give a *Nash equi-*  
 292 *librium*, that is, no unilateral improvement for any follower. The leader seeks a policy  
 293 that maximizes overall welfare. The mathematical formulation (2.5) of this problem  
 294 is called a *Mathematical Program with Equilibrium Constraints* or *MPEC*. In fact,  
 295 Mathematical Program with Equilibrium Constraints can encompass bilevel programs  
 296 where the lower level parametric optimization problem is replaced by its variational  
 297 form, thus

$$298 \quad \min_{(x,y) \in X} f_U(x,y) \text{ s.t. } g_U(x,y) \in K_U, y \in Y, \nabla_y f_L(x,y)^T(z-y) \geq 0, \forall z \in Y$$

299 where for notational ease we have simplified the lower level problem to

$$300 \quad (2.6) \quad \min_{z \in Y} f_L(x,z).$$

301 Assumptions are needed to guarantee that the variational form is necessary and suf-  
 302 ficient for optimality in (2.6).

303 The principal-agent problem is an instance of the bilevel programming problem.  
 304 In this case, the leader is the principal (owner) and the agent (manager) is the follower.  
 305 The agent's actions  $y = a$  are chosen to optimize their expected utility  $V_A(w, a)$  given  
 306 that the principal sets a reward  $x = w$ . The principal optimizes their expected  
 307 utility  $V_P(w, a)$ . Note that the agent only accepts the contract if  $V_A(w, a) \geq v_0$ , so a  
 308 participation constraint is added to the upper level problem. The bilevel form is thus:

$$309 \quad (2.7) \quad \max_{(w,a) \in X} V_P(w, a) \text{ s.t. } V_A(w, a) \geq v_0, a \in \arg \max_{z \in Y} V_A(w, z).$$

311 The last constraint in this model ensures that the chosen action is also the agent's  
 312 best response. It is of course possible to convert this to an MPEC under assumptions  
 313 that guarantee the lower level optimization can be replaced by its variational form.

314 **2.3. Forecasting models.** There is an enormous literature on forecasting that  
 315 utilizes methodologies such as deep neural nets, statistical learning [40] and data  
 316 analytics. In this paper we assume such methods are used to generate forecasts that  
 317 can be used for data provision in our models, but do not describe them further since  
 318 their black-box nature makes it difficult to interpret results and understand the model  
 319 constructs generated. Some references can be found in the following survey papers  
 320 [38, 70].

321 **3. Examples.** In this section we look at examples of problems arising in the ar-  
 322 chitecture of green energy systems that can be modeled using the approaches outlined  
 323 in section 2. Our catalog of examples is loosely ordered by their scale, from the small  
 324 to the large. Furthermore, the models are broadly conditioned on looking at issues  
 325 of flexibility in planning, ensuring the problems determine decisions on technologies  
 326 and capacities that are informed by operational characteristics of the desired energy  
 327 system.

328 **3.1. Household electricity planning.** The simplest agent engaged in the tran-  
 329 sition to green energy is the individual person or household. They make decisions on  
 330 the level and type of energy consumption for heating, refrigeration, cleaning, enter-  
 331 tainment, and transport. Households might choose to use a combination of rooftop  
 332 solar energy, batteries and electric vehicles to meet their needs. If they are exposed to



333 carbon charges and time-varying electricity prices, then they face a capacity planning  
 334 problem that chooses the capacity of solar panels, battery and car battery, and an  
 335 operating policy of electricity consumption and battery charging/discharging to meet  
 336 expected energy needs. This is a two-stage stochastic program in which the first stage  
 337 defines capacity choices and the second stage is an infinite-horizon stochastic optimal  
 338 control problem that defines the operating policy.

$$\begin{aligned}
 339 \quad & \min_{z,x,u} K(z) + V \\
 340 \quad & \text{s.t. } V = \mathbb{E}\left[\sum_{t=0}^{\infty} \beta^t f_t(x_t, u_t, \xi_t)\right], \\
 341 \quad & z \in Z, \quad x_t \in \mathcal{X}(z, \xi), \quad u_t \in \mathcal{U}(z, \xi).
 \end{aligned}$$

343 Note that the constraint set  $Z$  can encode many complicated engineering relationships  
 344 involving the investments  $z$ . The state variable  $x_t$  represents storage and the control  
 345  $u_t$  represents charge and discharge of storage as well as electricity purchases and load  
 346 shedding. The set  $\mathcal{U}(z, \xi)$  represents both household demand for electricity and supply  
 347 of power from investments  $z$ . The operating costs  $f_t(x_t, u_t, \xi_t)$  are discounted with  
 348 discount factor  $\beta$ . Details and data for the capital, operating and lost load costs  
 349 and the demand profile are not specified here, but represent samples for different  
 350 operational cases. Of course, many households make investment decisions in solar  
 351 panels and batteries without this sort of analysis as they are typically not exposed to  
 352 varying electricity price and the household savings from optimal operations are too  
 353 small to warrant the solution of a complicated optimization model.

354 While much of the energy management can be carried out “behind the meter”,  
 355 agents might interact directly with the electricity market whenever they have a deficit  
 356 or excess of power. Choices between purchase or load reduction (turning off appli-  
 357 ances) can be price directed. Some companies install solar panel systems with built  
 358 in controls that promise guaranteed electricity savings over a fixed time horizon, ob-  
 359 viating the need for households to optimize individually. Such disaggregated control  
 360 has some drawbacks as potential system stability problems may ensue if appliances  
 361 of many agents respond simultaneously to a single price signal without some coordi-  
 362 nation.

363 **3.2. Aggregators and micro grids.** Solar generation falls into two categories,  
 364 residential (often called roof-top) and utility-scale (often called solar farms). Deter-  
 365 mining the sizing of these farms is an optimization problem. Is it better to have a  
 366 large single facility or a distributed collection of smaller ones? The answer will de-  
 367 pend on land availability, and issues relating to the connection of this supply to the  
 368 electrical grid.

369 Aggregators combine household demand and solar generation into a single energy  
 370 source. This allows an aggregator to act as a virtual power plant and provide promises  
 371 to deliver at least a certain amount of power/energy in a given time frame. Individ-  
 372 ual households typically cannot make such strong promises due to variability in the  
 373 amount they can supply. Aggregation can reduce that variability, a property that  
 374 is utilized to give diversified investments in the financial industry. Additionally, an  
 375 aggregator can handle issues such as construction delays (a solar farm takes anywhere  
 376 from 6 to 12 months to build), local and municipal permitting and approval processes,  
 377 and ongoing maintenance and operation concerns [11]. The main concerns here are  
 378 electrical engineering issues (and possible legality) related to distributed injection of  
 379 supply, such as voltage support and frequency regulation. Questions arise around the

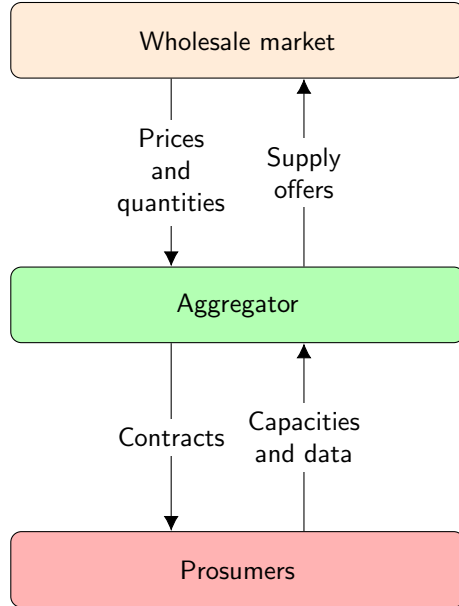


FIG. 2. *Aggregator as intermediary between prosumer and electricity market: based on [28]*

380 regulatory policy (see, e.g., [22]) vis-a-vis the size of the aggregate supplier, and also  
 381 to whether innovations such as digital transformers can provide alternative technical  
 382 solutions [51]).

383 A schematic showing the typical operation of an aggregator system is shown in  
 384 Figure 2.

385 Operational models for aggregators can vary. In [39], aggregators are the inter-  
 386 mediaries between a collection of prosumers (the combination of a producer and a  
 387 consumer) and the electricity market, whereas in [54] a different approach is taken  
 388 where consumers are aggregated in a demand response setting. The aggregator's de-  
 389 sign problem is to select from a collection of distributed solar energy sources those  
 390 that in aggregate will generate a certain volume of energy with the smallest variation  
 391 in output (essentially the Markowitz model [49] in finance). We consider a design  
 392 where solar energy sources are aggregated and augmented with batteries to smooth  
 393 short-time fluctuations. If we let  $Q$  represent the matrix of covariances in energy  
 394 output of solar sources,  $r$  be the vector of expected energy outputs, and  $x = (x_i)$  be  
 395 a binary variable that includes source  $i$  or not, we solve

$$\begin{aligned}
 396 \quad & \min_{x \in X} c^T x + \varphi(x^T Q x) \\
 397 \quad & \text{s.t. } r^T x \geq d.
 \end{aligned}$$

399  $X$  captures other constraints on  $x$ , and the objective adds the cost of solar installation  
 400 to the cost  $\varphi(\cdot)$  of batteries to deal with the overall variation in supply. The constraint  
 401 then ensures average power output is above a threshold for interactions with the  
 402 electricity grid.

403 In the context of distributed green energy systems, one concern is whether it is  
 404 better to design the system for local use (i.e. use rooftop solar to power residential  
 405 air conditioners directly behind the meter) and store excess locally in some form for

406 later use (disaggregated storage), or is it better to directly deliver the excess to the  
407 electricity market, or have an aggregator manage the (excess) supply? These choices  
408 are compounded by supply intermittency when the local user has a deficit of energy  
409 and needs to procure it from elsewhere. The choice of storage mechanism is part of  
410 the design, and requires understanding the usage pattern - short or long time storage,  
411 power or energy requirements. In another section we touch on other aspects of storage  
412 or aggregated control related to reliability guarantees of the overall system.

413 Direct interaction with the market by a prosumer can be modeled as a special  
414 case of the aggregator problem. Interactions with the electricity market are governed  
415 by standard mechanisms described in section 3.4. The remaining design decisions  
416 relate to the pricing of energy flows between the prosumer and the aggregator, and  
417 the mechanism to control the prosumer demand. For example, the aggregator can  
418 rent the consumer's roof at a fixed price, install its own solar panels, and then control  
419 the energy flows as part of a (large) virtual prosumer. An issue for the aggregator  
420 is to determine what roof space to rent and at what price (connection charge and  
421 per unit cost or payment), a so-called two-part pricing model. These models form a  
422 contract between the prosumer and the aggregator and such contracts can take on  
423 many forms. A rental contract could pay a fixed amount per month, or might provide  
424 retail power to the household at a reduced rate. The latter contract must specify how  
425 the price is indexed to the price of energy, and there is a need to understand how long  
426 term increases in demand will be treated, a topic that is well-understood by electricity  
427 retailers. Four different models of how to integrate distributed energy resources (DER)  
428 into electricity markets are given in [28]. They all rely on following a participant two-  
429 part pricing model (connection charge and selling price of the aggregator), but differ  
430 in the regulations that the aggregator faces.

431 Aggregation is also possible for plug-in electric vehicles that are currently con-  
432 trolled by their owners. Imagine a world where a fleet is owned and controlled by  
433 a corporation and cars are available on demand for a particular trip. This enables  
434 the corporation to control charging and vehicle use using a similar model to those  
435 outlined above.

436 **3.3. Distribution network architecture.** Distribution companies operate the  
437 low voltage networks that distribute electricity from the high voltage transmission  
438 grid to consumers. These operations are subject to variability from local demand  
439 and generation but also from equipment failure. Distribution companies can install  
440 special devices and configure the topology of the network to make it resilient to this  
441 variability. Dynamic topology control that switches lines in and out of the network  
442 also provides flexibility [26, 32, 33, 46]. For example, a mesh design (that provides  
443 redundancy in the form of multiple connection paths) can be configured as a radial  
444 network, allowing failures to be accurately identified and isolated. Lines (including  
445 those that are switched out) can be reinforced to reconnect the distribution service  
446 in case of failure (see for example [66]). In addition to these actions, the distribution  
447 company can procure flexibility services from battery storage or interruptible load. In  
448 a green energy system that has distributed battery capacity, these could be utilized for  
449 short term supply during a reconfiguration process. The type and amount of services  
450 to be procured depends on their offered cost, the existing flexibility actions available  
451 to the distribution company, and the level of reliability they require.

452 **3.4. Electricity system operations.** The economic dispatch model consists of  
 453 buses  $\mathcal{B}$ , lines  $\mathcal{L}$  and generators  $\mathcal{G} \subset \mathcal{B}$  in an optimization:

$$454 \quad (3.1) \quad \min_{(q, \theta, y) \in X} \sum_{i \in \mathcal{G}} c_i(q_i^g)$$

$$455 \quad (3.2) \quad \text{s.t.} \quad q_i^g - q_i^d = \sum_{j \in \delta^+(i)} y_{ij} - \sum_{j \in \delta^-(i)} y_{ji}, \quad i \in \mathcal{B}$$

$$456 \quad (3.3) \quad B_{ij}(\theta_i - \theta_j) = y_{ij}, \quad (i, j) \in \mathcal{L}$$

$$457 \quad (3.4) \quad -\bar{y}_{ij} \leq y_{ij} \leq \bar{y}_{ij}, \quad (i, j) \in \mathcal{L}$$

$$458 \quad (3.5) \quad q_i^{\min} \leq q_i^g \leq q_i^{\max}, \quad i \in \mathcal{G}$$

460 where  $\delta^+(i) = \{j \in \mathcal{B} : (i, j) \in \mathcal{L}\}$ ,  $\delta^-(i) = \{j \in \mathcal{B} : (j, i) \in \mathcal{L}\}$  specify the  
 461 network structure,  $B_{ij}$ ,  $q_i^{\min, \max}$ ,  $\bar{y}_{ij}$  are electrical properties and  $c_i$  are production  
 462 cost functions (most often linear or quadratic), and  $q_i^d$  is demand, see for example  
 463 [69]. Variables determine active generated power  $q^g$ , voltage phase angles  $\theta$  and  
 464 active power flows  $y$ . Extensions of this basic problem can be used to incorporate  
 465 different load conditions, failures, and maintenance schedules for instance (see for  
 466 example [41]).

467 Locational marginal prices (LMPs), defined by the Lagrange multipliers (dual  
 468 variables) on (3.2), can be shown to maximize total welfare of producers and con-  
 469 sumers in perfectly competitive markets under assumptions of convexity and com-  
 470 pleteness. Under some additional assumptions this is true in dynamic stochastic  
 471 settings as well [23]. This feature is becoming important for renewable systems with  
 472 storage.

473 Locational marginal prices are less attractive when optimizing systems with large  
 474 thermal plant having minimum operating levels and fixed costs for switching on and  
 475 off. In the setting above, we might add a constraint and binary variables  $x$

$$476 \quad q_i^{\min} x \leq q_i^g \leq q_i^{\max} x, x \in \{0, 1\}$$

478 to force a particular generator to operate at 0, or in the range  $[q_i^{\min}, q_i^{\max}]$ ,  $q_i^{\min} > 0$ .  
 479 Here the lack of convexity invalidates the classical welfare theorems. In practice  
 480 most system operators in LMP markets solve mixed integer programming problems  
 481 to determine what plant should run, and when. Marginal prices from such a dispatch  
 482 are not always sufficient to pay for generators' costs, and so "make-whole" payments  
 483 are required to provide incentives for participation in the market. See [5] for a recent  
 484 detailed discussion of the merits of such centrally dispatched systems in contrast to  
 485 self-dispatched systems.

486 Some electricity market system operators (such as New Zealand and Australia)  
 487 solve (convex) dispatch problems formulated as linear programs. To enable this they  
 488 require supply curves to represent minimum operating levels and start-up and shut-  
 489 down costs in the offered "marginal" cost curve. In other words, in a single-period  
 490 setting, a plant that is currently off might mark up the marginal cost of its offer by an  
 491 amount that would cover the cost of switching on if it were dispatched. A plant that  
 492 was currently operating would offer at a discount to ensure that it was not switched  
 493 off. Such a dispatch model treats these as truthful marginal cost declarations and  
 494 yields LMPs that reflect these. The welfare theorems of convex markets obviate the  
 495 need for make-whole payments.

496 There are two disadvantages with this approach. Unlike conventional marginal  
 497 costs that can be calculated from fuel costs and heat rates, amortized start-up and

498 shut-down costs are difficult to estimate. For example, should a start-up cost be  
499 amortized over a 30 minute period or over the expected period that the unit is on?  
500 To avoid a shortfall, suppliers will be conservative, and so the cost of dispatch will  
501 generally be higher than one obtained by solving a MIP. This loss in efficiency will be  
502 more pronounced when there are many large thermal units that can operate in dif-  
503 ferent combinations. A MIP that accurately models starts and shuts can cut through  
504 these to yield a less expensive dispatch.

505 A second disadvantage comes from the increased difficulty in monitoring the po-  
506 tential strategic behavior of market participants who are now freed from any imposed  
507 regulatory constraint to offer at short-run marginal cost. In markets that use MIPs  
508 to dispatch generation plant, the start-up and shut-down costs and no-load costs are  
509 also much harder to estimate than fuel costs, so there is admittedly a similar incentive  
510 for generators to mark these up above their true values without being detected.

511 As electricity markets include growing amounts of intermittent generation and  
512 storage devices, the make-whole payments required to incentivize participation have  
513 been increasing (see [35]). While LMPS are currently computed using deterministic  
514 models, the dynamic stochastic features of markets with green energy seem to require  
515 a different approach to price formation to properly reward flexibility [20]. It is possible  
516 that the replacement of coal and gas plant by wind and solar generators will decrease  
517 economies of scale and lead to dispatch problems that can be well approximated by  
518 convex stochastic optimization problems, reducing the need for make-whole payments.

519 Stochastic market clearing models have a new set of challenges, even if convexity  
520 can be assumed. Even in markets approximated as a two-stage stochastic program  
521 with a finite probability distribution the optimal solution cannot be both budget  
522 balanced (where the independent system operator does not lose money) and recover  
523 each agent’s costs (each market participant does not lose money) in every scenario (see  
524 [14]). It is possible under some strong assumptions on completeness of the risk market  
525 to ensure budget balance and cost recovery in risk-adjusted expectation which at  
526 least makes participation individually rational. A deeper philosophical problem with  
527 stochastic dispatch is an assumption that agents agree on the underling probability  
528 distribution used in the stochastic program. Rather than imposing a distribution,  
529 markets are supposed to be a mechanism for eliciting these probability distributions  
530 from a range of participants who each “put their money where their mouth is”.

531 Stochastic market clearing models must also be dynamic, treating many trading  
532 periods at once, so they are stochastic optimal control problems rather than two-stage  
533 problems. Since the realized values of random variables in the future will inevitably  
534 differ from those in any model, the optimal control problems need to be updated in a  
535 rolling horizon fashion, as these values are discovered. Currently, a number of markets  
536 adopt this rolling horizon approach in a deterministic setting where single forecasts  
537 are updated. Such look-ahead dispatch models can yield efficient dispatch solutions,  
538 but can cause consistency problems in the resulting LMPs [34].

539 **3.5. Load forecasting.** Estimating load on the electricity system is crucial for  
540 many, if not all, models. Load forecasting is often categorized into: 1) Short-term (one  
541 hour to one week), 2) Medium-term (week to a year), and 3) Long-term (longer than a  
542 year) settings that are appropriate for different use cases. New policy issues, disruptive  
543 technologies to facilitate the transition, engineering and economic enhancements that  
544 change usage patterns, and efforts to electrify both heating and transport lead to  
545 substantive changes in electric demand. In fact, the fast growth in the use of LLM’s  
546 across society and the world had led to huge increases in the use of computational

547 resources and consequently in energy to power them. Some see this as a principal  
548 limitation to the AI revolution. Such perturbations must be included in the load  
549 forecasts for them to be at all useful. A recent survey is provided in [53].

550 A popular approach is to use a neural network approach [6] for the load forecasts.  
551 The paper [74] solves an optimal load dispatch model of a grid-connected community  
552 microgrid which contains residential power load, photovoltaic arrays, electric vehicles  
553 (EV), and energy storage systems (ESS), under three contrasting scheduling scenarios.  
554 In the load dispatch model, the residential power load and the photovoltaic power  
555 output were obtained from the forecasting results of a neural net model. The total  
556 cost of the proposed model consists of transaction costs between the microgrid and the  
557 main power grid, depreciation cost of EV and ESS, and treatment cost of pollutant  
558 emissions. Simple limit constraints specify interaction with the electrical grid.

559 **3.6. Emissions trading.** Many countries have implemented cap-and-trade mar-  
560 kets for greenhouse gas emissions [3, 71]. These differ in their implementation but  
561 generally involve a decreasing cap on annual emissions permits that must be surren-  
562 dered each year by organizations to account for their emissions. The permits are  
563 auctioned by governments and traded in a secondary market. Given a price for a  
564 permit each emitter in the economy faces an optimization problem that equilibrates  
565 the price of permits against the marginal cost of reducing emissions.

566 In practice, emissions markets are subject to political intervention. Some sectors  
567 of the economy (e.g. farmers whose animals emit biogenic methane) are made exempt  
568 (at least temporarily) from surrendering permits. The reason is that the carbon charge  
569 imposes a cost that they cannot avoid in the short term by technological means. Extra  
570 costs might make them uncompetitive in international markets. This is unsustainable  
571 in the long run, as biogenic emissions must be reduced. Indeed many countries are  
572 beginning to add emission tariffs to imported goods, which effectively imposes the  
573 costs on farmers that were not imposed by emissions charges in their own country  
574 [52].

575 A second political intervention comes from the effect of emission charges on en-  
576 ergy prices, notably gasoline and electricity. These price increases affect poor house-  
577 holds disproportionately (as they spend a higher proportion of income on energy than  
578 wealthy households). Moreover poor households have limited access to cheap capital,  
579 so replacing legacy technologies such as gasoline cars and gas water heating is ex-  
580 pensive. This results in strong advocacy for energy subsidies or for more substantial  
581 income redistribution through taxation policy to enable poor households to reduce  
582 emissions.

583 Ideally a global cap-and-trade market would result in a world carbon price that  
584 would reduce emissions in the most efficient way. A number of authors (see e.g. [43])  
585 have pointed to potential deficiencies in such a market. Lack of effective verification  
586 of permits can cause “carbon leakage” to less compliant countries and weakening in  
587 permit prices as experienced for about ten years after 2008. There are also potential  
588 market failures. Consider a least-cost optimal solution for the world to reach a desired  
589 emission target that requires a poor country to face a large fixed cost to be able to  
590 reduce emissions (say by building a large hydroelectric dam). A global emissions  
591 price might be insufficient to incentivize this. A subsidy from the rest of the world  
592 will enable this solution to be realized.

593 There is an analogy here with make-whole payments in optimal dispatch, where  
594 the marginal energy price is insufficient to produce the socially optimal outcome.  
595 Make-whole payments incentivize participation of all generating plant in the optimal

596 dispatch solution.

597 **3.7. The role of storage, peaking and load shedding.** The most popular  
598 forms of green electricity are generated by the wind and the sun. These sources are  
599 both intermittent and uncertain. Intermittency (the fact that the sun does not shine  
600 at night) and the (random) variability (due to cloud cover or other effects) can be  
601 treated separately [73]. In some areas solar insolation is reasonably predictable but is  
602 not available at night time. If the solar power exceeds demand during the day and is  
603 not exported then some form of energy storage might be desirable to use the power  
604 generated during the day in the evening and night time. This storage is intended to  
605 be cycled on a daily basis, and will save its operators money by reducing night-time  
606 power consumption that must otherwise be bought off the grid [67]. Batteries are  
607 typically used to perform this function if the discounted electricity cost saved over  
608 the battery life covers its capital cost. Batteries also can be used to transfer energy  
609 between time periods for other variable sources of energy such as wind power [42].

610 Like any inventory, battery storage also plays a role when supply and demand are  
611 unpredictable [17]. Energy storage then provides a hedge against future uncertainty.  
612 The optimal sizing, location and operation of batteries under these circumstances  
613 requires a stochastic optimization model that represents the short-term uncertainty  
614 in supply, e.g., when predicted wind does not eventuate [77].

615 An alternative approach installs fast-start peaking generators to deal with uncer-  
616 tain and intermittent renewable energy supply. These typically are open-cycle natural  
617 gas turbines, but they could be configured to run on biofuel or green methane pro-  
618 duced from carbon capture and hydrogen. The optimal sizing, location and operation  
619 of such peaking plant also requires a stochastic optimization model. Instead of in-  
620 stalling peaking capacity, the system might arrange for (industrial) consumers to shed  
621 load in response to price. This *demand response* essentially performs the same func-  
622 tion as a peaking plant. Estimating demand response for different customer types  
623 requires some estimate of their marginal value of electricity, which is much harder  
624 to determine compared with a price of natural gas. Another alternative is to use a  
625 battery to provide the peaking functionality [18].

626 Storage can also operate over a longer time scale (see [63]). For example in some  
627 regions where energy supply is seasonal, hydroelectric reservoirs are used to transfer  
628 water from melting snow or wet season rainfall to dry seasons of the year. The water  
629 in these systems stores energy. In contrast to short-term battery storage that can be  
630 used to overcome a limitation on electricity *capacity*, reservoir storage is a response  
631 to seasonal *energy* limitations.

632 Specific mathematical models of batteries for use in storage models can be found  
633 in [59], for example.

634 **3.8. Transmission.** Electricity transmission architecture is a key component of  
635 the transition to green energy. Historically, transmission of electricity has been driven  
636 by economies of scale in generation. Electricity generation from large-scale coal and  
637 nuclear plant needs transmission to make it available to consumers that can be located  
638 many miles from generator locations. The cost of transmission lines has historically  
639 been low compared with the costs of proliferating small plants for local electricity  
640 generation. Even as these costs fall, transmission remains important since renewable  
641 sources of energy (e.g. offshore wind) are not always located where demand is.

642 In most electricity markets, transmission is separated from energy production, and  
643 is owned and operated by an independent regulated monopoly. Designing transmission  
644 systems to achieve desirable social outcomes is nevertheless a challenging optimization

645 problem. Examples of models that study this are [48] in a deterministic setting, [72]  
 646 in a setting with random wind and transmission switching, and [60] and [76] in a  
 647 principal-agent setting.

648 For switching problems, the economic dispatch problem can be updated to replace  
 649 constraints (3.3) and (3.4) by

$$650 \quad B_{ij}(\theta_i - \theta_j) - M_{ij}(1 - x_{ij}) \leq y_{ij} \leq B_{ij}(\theta_i - \theta_j) + M_{ij}(1 - x_{ij})$$

$$651 \quad -\bar{y}_{ij}x_{ij} \leq y_{ij} \leq \bar{y}_{ij}x_{ij},$$

653 for  $(i, j) \in \mathcal{L}$ , where  $M_{ij}$  represent so-called big-M constants that facilitate the switch-  
 654 ing on and off of a given line  $ij$ , and binary variables  $x$  represent switching decisions.

655 Reconfiguration and initial design share many similar features, particularly if a  
 656 given set of choices is specified a-priori. In this case, investment costs could be added  
 657 to the objective:

$$658 \quad \sum_{i \in G} c_i(q_i^g) + \sum_{ij} b_{ij}x_{ij}.$$

659 **3.9. Conversion of energy.** In general, it is possible to convert any form of  
 660 energy into another target form, having different properties from the source form.  
 661 Only 40% of the energy used in the United States is currently supplied by electricity.  
 662 The majority of the remaining 60% of energy is supplied by directly combusting fossil  
 663 fuels like gasoline to power cars or by burning natural gas for heat and cooking.

664 **3.9.1. Conversion for Storage.** As mentioned above, electricity can be con-  
 665 verted to a chemical form in a battery for example that allows for energy to be stored  
 666 over short time periods, or water can be pumped uphill creating potential energy for  
 667 later conversion using gravity and turbines. Such conversions are lossy, in that some  
 668 energy is expended and lost in the conversion process. Electricity is expensive to store  
 669 since it incurs these losses both in conversion and possibly over time due to leakage.

670 Storage also requires capital and this adds to the expense. Batteries have high  
 671 conversion efficiencies but have a high capital cost per MWh stored. A principal use  
 672 of batteries is therefore to transfer electrical energy over short time periods, allowing  
 673 repeated use of the battery over time to arbitrage prices so as to recover capital costs  
 674 from high utilization. The timing of charge/discharge can be determined effectively  
 675 using stochastic control models.

676 For longer time frames of storage, batteries are not as effective since they are  
 677 used less frequently and so cannot recover their capital costs. In this setting, there  
 678 may be conversions of the electrical energy that are less efficient from an energy  
 679 conversion perspective, but allow the energy to be moved across time to where it  
 680 is much more valuable. These conversions may even be relatively inexpensive from  
 681 a capital perspective, as they might only use excess capacity of existing/deployed  
 682 technologies (such as ammonia generation or hydrogen to methane conversion). More  
 683 generally, conversions could be done locally, converting generated energy into a form  
 684 suitable for local storage and later use at that location or for more effective transport  
 685 (e.g. methane is more easily transported in pipes with lower losses than hydrogen).  
 686 Optimization again can be used to determine what conversions to do, where to do  
 687 them, and at what scale.

688 **3.9.2. Portfolio of Storage.** System optimization models can shed light on  
 689 these conversions and which ones are effective in a given portfolio. We illustrate this  
 690 with a toy example. Consider a set  $K$  of different storage types (say ammonia, green



691 methane, hydrogen, pumped storage, and battery), with variables for the amount of  
 692 energy stored  $s_{kt}(\omega)$  in storage type  $k$  in a scenario  $\omega$  at time  $t = 1 \dots, T$ , and the  
 693 related charging  $q_{kt}^+(\omega)$  and discharging  $q_{kt}^-(\omega)$  profiles. Integer variables  $x_k$  determine  
 694 how many units of  $k$  are installed. The overall cost of operation is given by:

$$695 \quad \sum_k c_k x_k + (1/T) \mathbb{E} \left( \sum_{\omega, t} \gamma_k (q_{kt}^+(\omega) + q_{kt}^-(\omega)) + p_t(\omega) (q_{kt}^+(\omega) - q_{kt}^-(\omega)) \right)$$

696 where  $c_k$  is the per period capital charge for storage  $k$ ,  $\gamma_k$  represents the cost due to  
 697 cycling the battery and  $p_t(\omega)$  is the price paid for energy at  $t$ . The system dynamics  
 698 are modeled by:

$$699 \quad s_{k(t+1)}(\omega) = s_{kt}(\omega) + e_k q_{kt}^+(\omega) - q_{kt}^-(\omega)$$

700 where  $e_k$  is the charging efficiency, and composition of the portfolio of storage is  
 701 determined using:

$$702 \quad s_{kt}(\omega) \leq \mathcal{S}_k x_k$$

703 with  $\mathcal{S}_k$  being the size of a unit of the storage  $k$ . Residual demand  $r_t(\omega)$  is related to  
 704 storage via

$$705 \quad r_t(\omega) = \sum_k q_{kt}^-(\omega) - q_{kt}^+(\omega)$$

706 This can be augmented with spill on the left hand side (that is penalized in the  
 707 definition of cost perhaps) and the addition of a peaking plant supply on the right if  
 708 desired. The key to such models is in the data  $(K, T, c_k, e_k, \mathcal{S}_k, r_t(\omega))$ : we specify  $T$  as  
 709 the number of hours in a year, and generate the demand  $d_t(\omega)$  uniformly at random  
 710 (using an upper bound on the random sample in each time step generated by a seasonal  
 711 underlying curve supplemented by daily deviations to capture the day/night cycles).  
 712 Supply is specified so it provides an overbuild factor  $1 + \eta$  more than the demand  
 713 from generators, and residual demand is the difference of demand and supply. Other  
 714 data are taken from estimates in the literature.

715 Figure 3 shows optimal installed capacity and the number of charge/discharge  
 716 events for three different levels ( $\eta = 0.2, 0.4, 0.6$ ) of renewable overbuild, in a free  
 717 disposal regime without peaking plants. Installed battery capacity has high capital  
 718 costs so the storage capacity chosen is small. It is used primarily to deal with demand  
 719 peaks, so the frequency of its usage is large as shown in the lower panel of Figure 3.  
 720 At low levels of excess renewable energy supply, the portfolio of storage investment is  
 721 biased strongly towards the more efficient storage technologies (batteries and pump  
 722 storage) to use the excess energy most effectively to avoid shortages. As the levels of  
 723 renewable oversupply increase, ammonia and green methane become more attractive:  
 724 the energy wasted by these less efficient storage technologies is less costly if there  
 725 is a large surplus of energy and is outweighed by the lower capital cost of these  
 726 technologies. Fewer batteries are built as oversupply increases, since this reduces  
 727 peaking requirements that are increasingly handled by (less efficient) pump storage.

728 This simple model shows that a single choice of storage technology will not be  
 729 optimal: we require a mix of storage technologies depending on the level of renewable  
 730 overbuild. Of course the total costs of storage decrease as the amount of overbuilt  
 731 renewable capacity increases, so there will be an optimal setting where the marginal

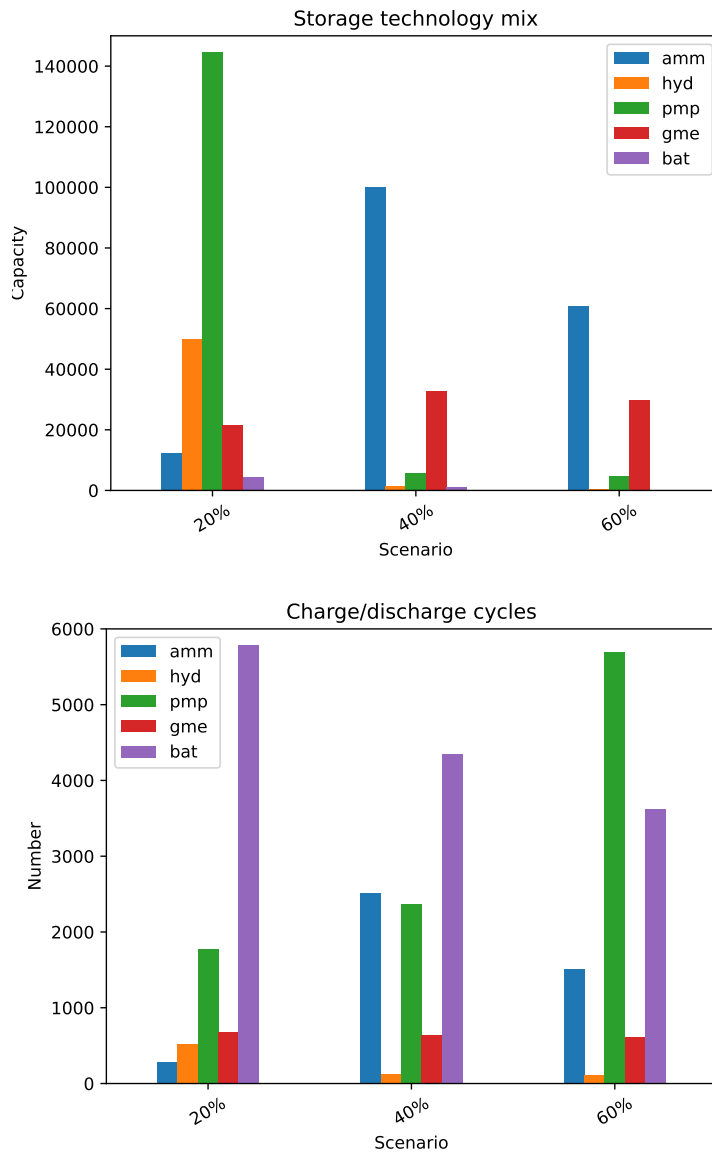


FIG. 3. Storage portfolio and charging frequency under different generation design scenarios.

732 cost of this equals the marginal decrease in storage cost. This is shown schematically  
 733 in Figure 4. With an appropriate representation of the transmission network, the  
 734 model can also be extended to determine the location of energy storage as well as its  
 735 technology and size.

736 **3.9.3. Conversion for Transport.** Electricity is what we call a secondary energy  
 737 source. It is created by converting primary sources of energy like fossil fuels, wind  
 738 and solar energy, into electricity. It is a particularly useful form of energy because it  
 739 can be quickly and efficiently transported over long distances and is readily usable in  
 740 a multitude of settings (lighting, heat, mechanics, transport, etc). Electricity is also

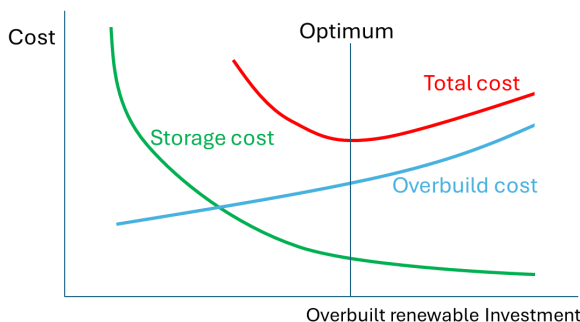


FIG. 4. *Optimizing renewable overbuild and storage*

741 referred to as an energy carrier, which means it can be reconverted to other forms of  
 742 energy such as mechanical energy or heat.

743 Transmission of electricity over long distances incurs losses through dissipated  
 744 heat. (These losses are reduced by increasing the voltage and decreasing the electrical  
 745 current.) The capital cost of the transmission infrastructure and the cost of energy  
 746 losses can be compared with alternative forms of energy transport.

747 For example, consider hydrogen. One could imagine converting electricity to  
 748 hydrogen gas at a large generation plant, transporting the hydrogen to a city, and  
 749 then storing it and converting it back to electricity through combustion or fuel cells  
 750 when it is needed. This enables the energy to be available at peak times. Note,  
 751 however, that each conversion incurs a loss of energy and hydrogen is very expensive  
 752 to transport (being light but requiring heavy pressure vessels, or susceptible to leaks  
 753 from conventional gas pipes).

754 An alternative model transports electricity to the city and makes hydrogen lo-  
 755 cally. Electrolysers to make hydrogen can be made cheaply at very small scale, and  
 756 require only electricity and fresh water as fuel. This means that electricity rather  
 757 than hydrogen is transported, and hydrogen can be made and stored locally where  
 758 the demand occurs. Such a model requires a transmission grid to be dimensioned to  
 759 meet extra demand, but avoids the much higher costs of hydrogen transport. The  
 760 model in subsection 3.9.2 can be easily extended to address these issues.

761 Demand for energy can change due to changes in behavior of users. There are  
 762 concerns about the electrification of urban transport expressed for example in [12].  
 763 While a very high gasoline tax would yield some interesting developments, it is unclear  
 764 how elastic the demand is, and whether such policies would lead to more working  
 765 from home, more use of public transport and electric vehicles. For another example,  
 766 air transportation is very energy intensive and currently not very green. Transition  
 767 strategies are focused on sustainable aviation fuel (SAF), liquid hydrogen and electric  
 768 power, both pure and hybrid [30]. The aggregation of transport by sea or pipeline  
 769 instead of airlines or trucking could reduce emissions substantially, perhaps at the  
 770 cost of longer transport times. Passenger travel via sea instead of by air might also  
 771 involve much longer times, but at a smaller energy cost per person. Models could  
 772 shed light on the underlying properties that are being utilized here - is the key simply  
 773 economies of scale? Tradeoffs based on behavior change are not limited to the energy  
 774 sector but will impact other sectors such as tourism and industrial productivity.

775 **3.10. Energy/resource tradeoffs.** Land is finite, and using it for energy gen-  
 776 eration such as in solar farms, or more generally for climate renewal as in reforestation,  
 777 precludes agricultural production or other uses. Similarly, biofuel production (corn  
 778 for ethanol instead of feed) and dam building for new hydro generation uses land for  
 779 energy while reducing its availability for other uses. In this context equilibrium mod-  
 780 els are relevant, allowing a price to determine efficient allocation of scarce resources  
 781 to a variety uses. Certainly, the tradeoff does not need to be limited to energy and  
 782 land, but could involve other finite resources, or other environmental concerns.

783 As mentioned in the introduction, many forms of green energy may involve some  
 784 use of finite resources. Batteries involve the extraction of rare-earth materials, and  
 785 deforestation occurs in the extraction of copper. How can our models capture these  
 786 effects? Do we need to consider more complex life cycle models accounting for all  
 787 inputs, for example. Or is a pricing mechanism an effective way to encourage capital  
 788 investment in alternatives?

789 More generally, energy generation and consumption is part of a broader economic  
 790 landscape where energy and the products and services it enables are transferred be-  
 791 tween different sectors of the economy. The effect of a change in the energy architec-  
 792 ture will be felt in all sectors and requires a model of the whole economy to evaluate.  
 793 Integrated Assessment Models (IAMs) of which there are many (see [55, 10]) aim to  
 794 model these intersectoral energy flows in a system optimization framework. Alterna-  
 795 tive approaches use computable general equilibrium models of the economy (see, e.g.,  
 796 [75, 10]).

797 **4. Risk.** In the classical finance literature, risk is identified with variance. In  
 798 some settings this makes it beneficial to reduce variance through aggregation. As in  
 799 the model of subsection 3.2, a collection of wind turbines with uncorrelated variable  
 800 wind generation can be aggregated to give a more predictable supply, which presents  
 801 advantages to economic dispatch models. Similarly the capital asset pricing model  
 802 translates variance in returns into a discount rate that can be used to assess the risk  
 803 of uncertain cash flows, so reducing variance with no change in expected reward is  
 804 deemed to be beneficial.

805 However, as noted by [50] the energy transition presents decision makers with  
 806 risks (downside variance) and opportunities (upside variance). Ideally, optimization  
 807 models should be able to take advantage of opportunities while minimizing risks.  
 808 In contrast with models that minimize variance, risk-averse stochastic programming  
 809 models using *coherent* risk measures [64] provide a principled approach for doing this.

810 Risk in settings with many agents requires careful handling. Each agent type  
 811 is exposed to a unique set of risks that arise from their technology choices, climate,  
 812 fuel source, exchange rates, and regulatory intervention. Some of these risks can be  
 813 reduced through hedge contracts signed with counterparties who see reward opportu-  
 814 nities in the risks faced by others. We give some examples of these transactions.

815 **4.1. Short-term risk instruments.** A popular form of hedge contract is called  
 816 a *contract for differences* (CFD). Arranged at some strike price  $f$ , this is a financial  
 817 agreement to pay a counterparty  $p - f$  where  $p$  is the observed price of electricity.  
 818 So if party A intends to sell  $Q$  MWh to counterparty B at some future time, then  $Q$   
 819 CFDs arranged at  $f$  will hedge the unknown future price and conduct the transaction  
 820 at known price  $f$ .

821 Weather derivatives are also a mechanism for reducing risk. Consider distributed  
 822 solar, and demand from air-conditioning. In the event of a very sunny day, the air  
 823 conditioners need more energy to run and the price would rise, but solar farms are

824 producing more. A weather derivative in which the solar farm guarantees the air  
825 conditioner a certain amount of energy whenever the temperature (or insolation) is  
826 above a certain level will reduce the risk of losses of both parties.

827 For a second example of weather-based derivatives consider a geothermal genera-  
828 tor. This has high capital costs and very low operating costs, so it make sense to run  
829 as a base-load plant. In the middle of the day when solar power is at a maximum,  
830 it might make sense for the electricity system to control geothermal output to avoid  
831 spilling energy. A solar farm might arrange a derivative contract with a geothermal  
832 plant that pays out when the sun shines, but imposes a cap on geothermal output at  
833 this time[36].

834 Can hedge contracts remove all risk? In an uncertain environment an *Arrow-*  
835 *Debreu security* is a derivative contract that pays \$1 to the holder if a particular  
836 future state of the world occurs. If these exist for every possible future state then in  
837 principle an agent can insure against any conceivable loss (at some ex-ante cost) by  
838 purchasing an appropriate Arrow-Debreu security off a counterparty.

839 This highly idealized situation would never occur in practice but it is a useful  
840 model to study risk and contracts. A relatively recently developed theory (see [61, 56,  
841 23]) shows that if markets for energy are perfectly competitive and convex, and all  
842 agents are endowed with coherent risk measures, and the market for Arrow-Debreu  
843 securities is complete, then agents will trade their risk using these securities until  
844 no more risk can be hedged. The remaining risk is then treated by each agent as  
845 if they were using the risk measure of the least risk-averse agent. For example if  
846 some agents such as speculators were actually risk-neutral then a complete market  
847 for Arrow-Debreu securities will result in every agent optimizing the expectation of  
848 their costs and benefits (i.e., acting as neutral to risk). This theory enables one to  
849 establish useful welfare theorems that demonstrate that the markets deliver socially  
850 optimal outcomes.

851 In practice, risk markets are incomplete, so the welfare theorems do not hold.  
852 Computational studies show that removing some risk using CFDs and other instru-  
853 ments can improve welfare outcomes in incomplete markets. It is also possible to find  
854 counterexamples where adding instruments makes welfare worse [4]. Furthermore the  
855 computation of equilibria in incomplete settings is difficult as these might fail to exist  
856 or not be unique [29]. This is an active area of research in scientific computation (see,  
857 e.g. [44, 37]).

858 **4.2. Long-term risk.** The transition from a largely fossil-fueled energy system  
859 to a renewable system is expected to take decades. Although we can develop sophis-  
860 ticated planning models to guide the decisions made, these decisions will in many  
861 cases be made by commercial organizations in pursuit of profits, but also facing many  
862 uncertainties. Investment in energy production and infrastructure development is fi-  
863 nanced largely by borrowing, and the cost of this finance depends on the risk of the  
864 investment, and so organizations making investment decisions need to understand the  
865 risk of the investment as well as its (uncertain) reward.

866 Capacity investments must make non-negative risk-adjusted returns to be justi-  
867 fied. In the risk-averse stochastic programming setting this amounts to a non-negative  
868 net present value with stochastic discount rates. In a complete market for risk, the  
869 trade of Arrow-Debreu securities leads companies to share the same stochastic dis-  
870 count rates. This allows the optimal capacity decisions for companies to be determined  
871 by a social planner who maximizes social NPV with the same discounting.

872 In practice, as in the short-term setting, risk markets are not complete, so a social

873 planning solution might not match a risked equilibrium. The latter, however, can often  
 874 be computed as the solution to a complementarity problem. As an example, consider  
 875 the following equilibrium problem formulated in [14] where each generator chooses  
 876 generating capacities and generation levels and retailers of energy choose amounts to  
 877 buy<sup>1</sup>. Each agent  $a$  solves the problem:

$$\begin{aligned}
 878 \quad P(a) : \quad & \min_{(\mathbf{x}^a, \mathbf{z}^a, \mathbf{q}^a) \geq 0} \rho^a(Z^a) \\
 879 \quad & \text{s.t. } Z^a(\omega) = \sum_{k \in \mathcal{K}} K_k \cdot z_k^a \\
 880 \quad & + \sum_{t \in \mathcal{T}} \sum_{k \in \mathcal{K}} (c_{kt}(\omega) - \pi_t(\omega)) \cdot x_{kt}^a(\omega) \\
 881 \quad & + \sum_{t \in \mathcal{T}} (\pi_t(\omega) - r) \cdot (d_t^a(\omega) - q_t^a(\omega)) \\
 882 \quad (4.1) \quad & + \sum_{t \in \mathcal{T}} v \cdot q_t^a(\omega) \qquad \qquad \qquad \forall \omega \in \Omega,
 \end{aligned}$$

$$883 \quad (4.2) \quad x_{kt}^a(\omega) \leq m_{kt}(\omega) \cdot z_k^a \qquad \qquad \forall k \in \mathcal{K}, \omega \in \Omega, t \in \mathcal{T},$$

$$884 \quad (4.3) \quad \sum_{t \in \mathcal{T}} x_{kt}^a(\omega) \leq n_k(\omega) \cdot z_k^a \qquad \qquad \forall k \in \mathcal{K}, \omega \in \Omega$$

$$885 \quad (4.4) \quad q_t^a(\omega) \leq d_t^a(\omega) \qquad \qquad \forall \omega \in \Omega, t \in \mathcal{T}.$$

887 The objective for each agent,  $a$ , is to minimize their own risk-adjusted disbenefit  
 888  $\rho^a(Z^a)$ . Here  $\rho^a$  is a coherent risk measure and  $Z^a(\omega)$  is the net cost from investing  
 889 and operating their fleet of generation in scenario  $\omega$  as defined by equation (4.1). The  
 890 constraints contain terms for both generators and retailers and so some will not be  
 891 present for each type of agent. The generator  $a$  produces  $x_{kt}^a(\omega)$  from plant type  $k$  and  
 892 the retailer buys power at wholesale price  $\pi_t(\omega)$  and sells it at fixed price  $r$ . In the first  
 893 line of equation (4.1), we have the physical capacity investment cost,  $\sum_{k \in \mathcal{K}} K_k \cdot z_k^a$ ,  
 894 where the sum is over investment technologies. In the second line of equation (4.1),  
 895 we have the component of the disbenefit from generation,  $(\mathbf{c} - \boldsymbol{\pi})\mathbf{x}$ , with  $\mathbf{c}$  giving the  
 896 marginal cost of generation,  $\boldsymbol{\pi}$  the spot market price, and  $\mathbf{x}$  the output of generation.

897 In the third term, we define the disbenefit from meeting demand. The per unit  
 898 cost of meeting demand is given by  $\boldsymbol{\pi} - r$  with the agent having to purchase the  
 899 electricity directly from the spot market at  $\boldsymbol{\pi}$  and given  $r$  by the consumer. The  
 900 demand met by the retail component of the agent is given by  $\mathbf{d} - \mathbf{q}$ . The exogenous  
 901 demand of each consumer is given by  $\mathbf{d}$ , and  $\mathbf{q}$  is how much the retail company decides  
 902 to curtail. The overall profit is given by  $(\boldsymbol{\pi} - r)(\mathbf{d} - \mathbf{q})$ .

903 In the final term, we define the penalty the retail agent must pay for unmet  
 904 demand,  $\mathbf{q}$ . The penalty is the value of lost load,  $\mathbf{v}$ , which is much higher than  
 905 typically observed spot market prices. This penalty is added to the lost revenue from  
 906 not meeting all of the consumer demand for electricity generation.

907 In equations (4.2) through (4.4), we define the physical constraints on generation  
 908 and curtailment. Equation (4.2) limits the power output  $\mathbf{x}$  of each plant, depending  
 909 on the capacity investment  $\mathbf{z}$  and some multiplicative adjustment,  $\mathbf{m}$ , that depends on  
 910 the scenario and load block. Equation (4.3) limits the energy output of a generation

<sup>1</sup>In [14] there is also an ISO agent that dispatches power through a transmission network. We assume a single node model for simplicity.

911 plant. Finally, equation (4.4) limits consumption to be at most the level of demand.

912 To form a complementarity problem, the KKT conditions from problem  $P(a)$  for  
 913 each agent  $a$  are added to the following market clearing conditions:

$$914 \quad 0 \leq \sum_{a \in \mathcal{A}, k \in \mathcal{K}} x_{kt}^a(\omega) + \sum_{a \in \mathcal{A}} q_t^a(\omega) - \sum_{a \in \mathcal{A}} d_t^a(\omega) \perp \pi_t(\omega) \geq 0, \quad \forall \omega \in \Omega, t \in \mathcal{T},$$

$$915 \quad 0 \leq \sum_{a \in \mathcal{A}} q_t^a(\omega) \perp \mathbf{r} + \mathbf{v} - \pi_t(\omega) \geq 0, \quad \forall \omega \in \Omega, t \in \mathcal{T}.$$

916  
 917 These complementarity conditions ensure that supply meets demand at a competitive  
 918 price. We have free disposal of power within our model, allowing supply to exceed  
 919 demand at each node. However, when this occurs, the spot market price for electricity  
 920 at this node will be 0. And when some positive amount of load is shed then the price  
 921 hits its maximum value  $\mathbf{r} + \mathbf{v}$ . As mentioned above, the incompleteness of the market  
 922 for trading risk complicates the existence, uniqueness and computation of equilibrium  
 923 in these models, but in many practical instances equilibria exist and can be computed  
 924 (see [47] and [4]).

925 As alluded to by [50], long-term investment decisions should maximize opportu-  
 926 nity while controlling risk. Stochastic programming models that represent such real  
 927 options are multistage, since opportunities are revealed over time as random variables  
 928 are realized. Multistage risk-averse optimization has many variations depending on  
 929 the form of conditional risk measure used. We mention two.

930 Given an adapted set of actions at each node of a scenario tree, an *end-of-horizon*  
 931 risk measure sums the payoffs at each node along a path from root to leaf to give a  
 932 scenario payoff. The risk of the set of actions is then evaluated using a coherent risk  
 933 measure applied to this distribution of scenario payoffs. This is the predominant risk  
 934 measure used in software for solving multistage models of capacity expansion under  
 935 uncertainty (see, e.g., [19]).

936 Given an adapted set of actions at each node of a scenario tree, a *nested* risk  
 937 measure computes the risk-adjusted payoff at the parent of each leaf node, using the  
 938 payoffs at this node and its children. This risked “value-to-go” function is then used  
 939 to evaluate the risk-adjusted payoff of the set of decisions at the grandparent of each  
 940 leaf in a recursive pattern. This recursive definition ensures that the dynamic risk  
 941 measure is time-consistent.

942 Dynamic risked equilibrium (see [23]) of many agents can be viewed as an open-  
 943 loop problem or a closed-loop problem. In the former setting, agents choose every  
 944 action in every state of the world on day 1, assuming other agents have fixed theirs.  
 945 The response of an agent is then computed in response to this knowledge. Such an  
 946 equilibrium is not subgame perfect. In a closed-loop equilibrium, an equilibrium is  
 947 computed for every state of the world at the final time. The payoffs in this equi-  
 948 librium then inform actions at the penultimate time, and the solution is computed  
 949 recursively. As shown in [23], these two solution concepts yield the same result in  
 950 perfectly competitive convex markets with complete risk markets. In imperfect or  
 951 incomplete markets they are not the same. Developing computational methods for  
 952 these problems is an active area of research (see [65]).

953 Why are these models important? Much effort has been devoted to developing inte-  
 954 grated assessment models (IAMs) for understanding the transition to green energy.  
 955 These models are (often deterministic) social planning models with high levels of phys-  
 956 ical fidelity, but treating the future as predictable scenarios. Including uncertainty  
 957 and risk aversion in these models makes them more realistic, but the results need

958 to be reconciled with commercial investment decisions of competing agents. Welfare  
 959 theorems give some justification for using risk-averse IAMs as gold-standard bench-  
 960 marks for the dynamic risked equilibria in incomplete markets that we believe are  
 961 closer representations to what will actually occur.

962 **4.3. Architecture for resilience.** Unexpected outages (that can arise from  
 963 operator mistakes, major storms or environmental disturbances, or even deliberate  
 964 sabotage by adversarial actors) are a general concern in electrical energy systems.  
 965 However, the more distributed nature of green energy systems may allow some en-  
 966 hancements, whereby cascading failures can be avoided by isolating subnetworks of  
 967 the overall grid. Since more batteries or other storage devices are installed (to provide  
 968 transfer of energy over time), those same resources could be made available (along with  
 969 existing distributed generation) to facilitate balancing while isolated. This is a novel  
 970 use of additional functionality installed in the system to improve overall resilience.

971 In any disaggregated system, the need arises for additional information to facili-  
 972 tate better overall control and stability. There is a large existing literature in the  
 973 energy domain related to information, privacy and mechanism design (for markets,  
 974 auctions, etc). The underlying question regarding the much finer scales of disaggrega-  
 975 tion that might come about in a green energy system brings up questions as to whether  
 976 these existing mechanisms are sufficient in these new operating environments, or what  
 977 changes and enhancements are needed.

978 **4.4. Capacity markets.** The transition to green energy will be costly. Accord-  
 979 ing to the International Energy Agency over 60% of the world's electricity in 2021  
 980 was generated from fossil fuels. Given that total electricity generation will increase  
 981 from electrification of transport and industrial processes, the scale of the investment  
 982 in green electricity capacity is immense.

983 This raises several important questions. What incentive structures are needed  
 984 to ensure that the right mix of capacity is built? Is the dynamic risked equilibrium  
 985 that emerges from commercial decisions enough to give the capacity increases that we  
 986 need? Finally, will this equilibrium be achieved in time to avert a climate catastrophe?

987 The first question is an area of active research. As mentioned in subsection 3.4  
 988 locational marginal prices (LMPs) are not always sufficient to incentivize optimal par-  
 989 ticipant behavior. In perfectly competitive, convex energy-only markets LMPs provide  
 990 economic rents that support optimal levels of investment at the margin determined  
 991 by a *screening-curve* analysis [68] as depicted in Figure 5.

992 The screening curve shows the annual total cost per MW capacity plotted against  
 993 the number of annual operating hours. The total cost is a combination of fixed and  
 994 variable cost based on the number of production hours in a year. A minimum cost  
 995 for each capacity factor can be found by combining the screening curve with the *load*  
 996 *duration curve* (LDC), here approximated by 10 load blocks with piecewise constant  
 997 demand. The projection produces the least-cost capacity combination that can serve  
 998 the load profile. For example, to supply the part of the LDC that has higher capacity  
 999 factor (*i.e.*, running most of the year), base load is the least cost option. As the  
 1000 number of operating hours decreases, the plants that are less expensive to build but  
 1001 more costly to run begin to become more economical. For a small number of hours  
 1002 at the tip of the duration curve, high variable cost peakers are the most economical.

1003 This picture is complicated by intermittent generation sources that are not dis-  
 1004 patchable, and by risk aversion that affects the equilibrium as discussed in the previous  
 1005 section. And even in the simple deterministic case, energy prices might need to be  
 1006 very high on occasions to sustain the peaking investment needed to make the system



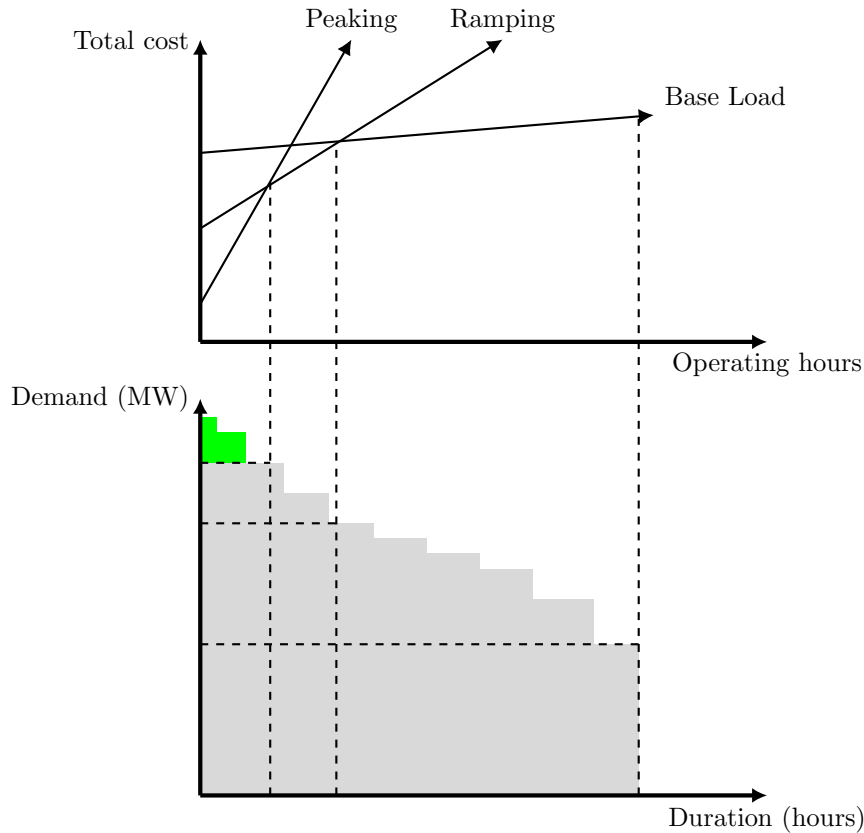


FIG. 5. *The screening curve: how capacity is traditionally planned in electricity systems.*

1007 avoid shedding load. For example if load shedding is acceptable in at most four or five  
 1008 hours per year, then prices need to become very high to pay for the annual capital cost  
 1009 of a peaking plant that runs only during these periods. The uncertainty of receiving  
 1010 these cash flows every year makes such an investment too risky.

1011 Contracts between energy suppliers can resolve some of the risks faced by gener-  
 1012 ators in deciding capacity investments. For example, a hydroelectric generator could  
 1013 arrange a two-way option contract with a coal plant to keep the coal plant available  
 1014 for periods of low reservoir inflows. The hydroelectric generator buys a call option  
 1015 off the coal plant, and the coal plant buys a put option (at a lower strike price) from  
 1016 the hydro generator. These contracts (that can be arranged to have the same price)  
 1017 enable the coal plant to receive revenue even when wholesale prices are below its  
 1018 marginal cost of generation in return for some loss of revenue in peak periods.

1019 *Capacity markets* that arrange additional payments for committed generation  
 1020 capacity ahead of time are a popular mechanism intended to overcome these problems.  
 1021 Opinions differ on the effectiveness of these mechanisms in comparison with energy-  
 1022 only markets, and studying their design and operation is an active area of research.

1023 In dealing with the transition to green energy, capacity markets serve to answer  
 1024 the second question as they can procure the desired capacity of different energy tech-  
 1025 nologies at auction. So governments can decide to increase this as needed to meet  
 1026 demand growth. It is not clear whether the same outcome might be achieved at lower

1027 cost with an energy-only solution.

1028 The final question of timing is important. A green-energy risked equilibrium must  
 1029 be viewed over a long time scale and achieve a green energy system in time to avert  
 1030 a climate catastrophe. Dynamic equilibrium models might give some confidence that  
 1031 commercial investment will deliver in time, but betting the planet's future on this  
 1032 might be too risky for policy makers. As evidence of climate change becomes more  
 1033 obvious, generational shifts in voter preferences might lead to more direct government  
 1034 intervention in planning and implementing the transition. In this case, relying on com-  
 1035 petitive electricity markets to achieve the transition might be viewed by governments  
 1036 as too much of a risk.

1037 **5. Conclusions.** In this paper we have outlined some of the questions arising  
 1038 in the transition to green energy, and presented some mathematical approaches to  
 1039 address them. The models we discuss are formulations of optimization problems  
 1040 and related complementarity problems, in settings with a variety of physical scales,  
 1041 and dealing with different time scales. The costs of the physical and institutional  
 1042 architecture required to bring about the transition will be substantial and will involve  
 1043 risk. Mathematical models will be essential in understanding the complex tradeoffs  
 1044 that have to be made in planning and incentivizing the transition to enable it to occur  
 1045 at a low cost and in time to avoid global temperatures rising to unacceptable levels.

1046 **Acknowledgments.** We would like to acknowledge the contributions of Laura  
 1047 Diaz Anadon and Dennice Gayme to this document.

1048

#### REFERENCES

- 1049 [1] *Green protectionism will slow the energy transition*, Economist, (December 9, 2023).  
 1050 [2] *The renewables business faces a make-or-break moment*, Economist, (December 9, 2023).  
 1051 [3] *How carbon prices are taking over the world*, Economist, (October 1, 2023).  
 1052 [4] I. ABADA AND A. EHRENMANN, *When market incompleteness is preferable to market power: Insights from power markets*, Available at SSRN 4402888, (2023).  
 1053 [5] V. AHLQVIST, P. HOLMBERG, AND T. TANGERÅS, *A survey comparing centralized and decentralized electricity markets*, Energy Strategy Reviews, 40 (2022), p. 100812.  
 1054 [6] K. AMARASINGHE, D. L. MARINO, AND M. MANIC, *Deep neural networks for energy load forecasting*, in 2017 IEEE 26th International Symposium on Industrial Electronics (ISIE),  
 1055 IEEE, June 2017, <https://doi.org/10.1109/isie.2017.8001465>.  
 1056 [7] P. BARBROOK-JOHNSON, J.-F. MERCURE, S. O. SHARPE, C. PEÑASCO, C. HEPBURN, L. D.  
 1057 ANADON, J. D. FARMER, AND T. M. LENTON, *Economic modelling fit for the demands of energy decision makers*, Nature Energy, (2024), <https://doi.org/10.1038/s41560-024-01452-7>.  
 1058 [8] D. BERTSEKAS AND S. SHREVE, *Stochastic optimal control: the discrete-time case*, vol. 5, Athena  
 1059 Scientific, 1996.  
 1060 [9] D. BERTSIMAS AND M. SIM, *The price of robustness*, Operations Research, 52 (2004), pp. 35–53.  
 1061 [10] C. BÖHRINGER AND T. F. RUTHERFORD, *Integrating bottom-up into top-down: A mixed complementarity approach*, SSRN Electronic Journal, (2005), <https://doi.org/10.2139/ssrn.770725>.  
 1062 [11] S. BURGER, J. P. CHAVES-ÁVILA, C. BATLLE, AND I. J. PÉREZ-ARRIAGA, *A review of the value of aggregators in electricity systems*, Renewable and Sustainable Energy Reviews, 77  
 1063 (2017), pp. 395–405, <https://doi.org/10.1016/j.rser.2017.04.014>.  
 1064 [12] S. CLOETE, *The 10 big problems with simply replacing fossil cars with electric*, Dec. 2021, <https://energypost.eu/the-10-big-problems-with-simply-replacing-fossil-cars-with-electric/>.  
 1065 [13] T. COPELAND AND V. ANTIKAROV, *Real Options: A Practitioner's Guide*, Texere, 2001, <https://books.google.co.nz/books?id=fnhPAAAAMAAJ>.  
 1066 [14] R. CORY-WRIGHT, A. PHILPOTT, AND G. ZAKERI, *Payment mechanisms for electricity markets with uncertain supply*, Operations Research Letters, 46 (2018), pp. 116–121.  
 1067 [15] R. DE NEUFVILLE AND S. SCHOLTES, *Flexibility in Engineering Design*, The MIT Press, 2011,  
 1068 <https://doi.org/10.7551/mitpress/8292.001.0001>.  
 1069

- 1080 [16] T. DE RUBIRA AND A. WIGINGTON, *Extending complementarity-based approach for handling*  
 1081 *voltage band regulation in power flow*, in 2016 Power Systems Computation Conference  
 1082 (PSCC), IEEE, 2016, pp. 1–6.
- 1083 [17] P. DENHOLM, E. ELA, B. KIRBY, AND M. MILLIGAN, *The Role of Energy Storage with Renewable*  
 1084 *Electricity Generation*, Office of Scientific and Technical Information (OSTI), Jan. 2010,  
 1085 pp. 1–61, <https://doi.org/10.2172/972169>.
- 1086 [18] P. DENHOLM, J. NUNEMAKER, P. GAGNON, AND W. COLE, *The potential for battery energy*  
 1087 *storage to provide peaking capacity in the United States*, *Renewable Energy*, 151 (2020),  
 1088 pp. 1269–1277, <https://doi.org/10.1016/j.renene.2019.11.117>.
- 1089 [19] A. DOWNWARD, R. BAUCKE, AND A. PHILPOTT, *JuDGE.jl: a Julia package for optimizing*  
 1090 *capacity expansion*, *Optimization Online*, (2020), [https://optimization-online.org/2020/](https://optimization-online.org/2020/11/8086/)  
 1091 [11/8086/](https://optimization-online.org/2020/11/8086/).
- 1092 [20] B. ELDRIDGE, B. KNUEVEN, AND J. MAYS, *Rethinking the price formation problem—part 1:*  
 1093 *Participant incentives under uncertainty*, *IEEE Transactions on Energy Markets, Policy*  
 1094 *and Regulation*, (2023).
- 1095 [21] A. FATTAHI, J. SIJM, AND A. FAAIJ, *A systemic approach to analyze integrated energy system*  
 1096 *modeling tools: A review of national models*, *Renewable and Sustainable Energy Reviews*,  
 1097 133 (2020), p. 110195.
- 1098 [22] FEDERAL ENERGY REGULATORY COMMISSION, *Order no. 2222: Participation of distributed*  
 1099 *energy resource aggregations in markets operated by regional transmission organiza-*  
 1100 *tions and independent system operators*, 2020, [https://www.ferc.gov/sites/default/files/](https://www.ferc.gov/sites/default/files/2020-09/E-1.0.pdf)  
 1101 [2020-09/E-1.0.pdf](https://www.ferc.gov/sites/default/files/2020-09/E-1.0.pdf).
- 1102 [23] M. FERRIS AND A. PHILPOTT, *Dynamic risked equilibrium*, *Operations Research*, 70 (2022),  
 1103 pp. 1933–1952.
- 1104 [24] M. C. FERRIS AND J. S. PANG, *Engineering and Economic Applications of Comple-*  
 1105 *mentarity Problems*, *SIAM Review*, 39 (1997), pp. 669–713, [https://doi.org/10.1137/](https://doi.org/10.1137/S0036144595285963)  
 1106 [S0036144595285963](https://doi.org/10.1137/S0036144595285963).
- 1107 [25] M. C. FERRIS AND A. PHILPOTT, *Renewable electricity capacity planning with uncertainty at*  
 1108 *multiple scales*, *Computational Management Science*, 20 (2023), [https://doi.org/10.1007/](https://doi.org/10.1007/s10287-023-00472-0)  
 1109 [s10287-023-00472-0](https://doi.org/10.1007/s10287-023-00472-0). 10.21203/rs.3.rs-2207695/v1.
- 1110 [26] E. B. FISHER, R. P. O’NEILL, AND M. C. FERRIS, *Optimal Transmission Switching*, *IEEE*  
 1111 *Transactions on Power Systems*, 23 (2008), pp. 1346–1355, [https://doi.org/10.1109/](https://doi.org/10.1109/TPWRS.2008.922256)  
 1112 [TPWRS.2008.922256](https://doi.org/10.1109/TPWRS.2008.922256), <http://www.cs.wisc.edu/~ferris/papers/transmission.pdf>.
- 1113 [27] S. A. GABRIEL, A. J. CONEJO, B. F. FULLER, J. DAVID AN D HOBBS, AND C. RUIZ, *Com-*  
 1114 *plementarity Modeling in Energy Markets*, Springer New York, 2013, [https://doi.org/10.](https://doi.org/10.1007/978-1-4419-6123-5)  
 1115 [1007/978-1-4419-6123-5](https://doi.org/10.1007/978-1-4419-6123-5).
- 1116 [28] Z. GAO, K. ALSHEHRI, AND J. R. BIRGE, *Aggregating distributed energy resources: Efficiency*  
 1117 *and market power*, *Manufacturing and Service Operations Management*, (2024), [https://doi.org/10.1287/](https://doi.org/10.1287/msom.2021.0539)  
 1118 [msom.2021.0539](https://doi.org/10.1287/msom.2021.0539).
- 1119 [29] H. GÉRARD, V. LECLÈRE, AND A. PHILPOTT, *On risk averse competitive equilibrium*, *Operations*  
 1120 *Research Letters*, 46 (2018), pp. 19–26.
- 1121 [30] S. GÖSSLING AND C. LYLE, *Transition policies for climatically sustainable aviation*, *Transport*  
 1122 *Reviews*, 41 (2021), pp. 643–658, <https://doi.org/10.1080/01441647.2021.1938284>.
- 1123 [31] S. J. GROSSMAN AND O. D. HART, *An analysis of the principal-agent problem*, *Econometrica*,  
 1124 51 (1983), p. 7, <https://doi.org/10.2307/1912246>.
- 1125 [32] J. HAN AND A. PAPAVALIOU, *The impacts of transmission topology control on the European*  
 1126 *electricity network*, *IEEE Transactions on Power Systems*, 31 (2016), pp. 496–507, <https://doi.org/10.1109/tpwrs.2015.2408439>.
- 1127 [33] K. W. HEDMAN, M. C. FERRIS, R. P. O’NEILL, E. B. FISHER, AND S. S. OREN, *Co-optimization*  
 1128 *of Generation Unit Commitment and Transmission Switching with N-1 Reliability*, *IEEE*  
 1129 *Transactions on Power Systems*, 25 (2010), pp. 1052–1063, [https://doi.org/10.1109/](https://doi.org/10.1109/TPWRS.2009.2037232)  
 1130 [TPWRS.2009.2037232](https://doi.org/10.1109/TPWRS.2009.2037232), <http://www.cs.wisc.edu/~ferris/papers/Hedman{ }GenUC.pdf>.
- 1131 [34] W. HOGAN, *Electricity market design: Multi-interval pricing models*, [https://scholar.harvard.](https://scholar.harvard.edu/files/whogan/files/hogan_hepg_multi_period_)  
 1132 [edu/files/whogan/files/hogan\\_hepg\\_multi\\_period\\_](https://scholar.harvard.edu/files/whogan/files/hogan_hepg_multi_period_), 62220 (2020).
- 1133 [35] C. HOHL, C. PRETE, AND M. RADHAKRISHNAN, A. AND WEBSTER, *Intraday markets, wind*  
 1134 *integration and uplift payments in a regional us power system*, *Energy Policy*, 175 (2023),  
 1135 p. 113503.
- 1136 [36] H. HOSCHLE, H. L. CADRE, Y. SMEERS, A. PAPAVALIOU, AND R. BELMANS, *An ADMM-based*  
 1137 *method for computing risk-averse equilibrium in capacity markets*, *IEEE Transactions on*  
 1138 *Power Systems*, (2018), <https://doi.org/10.1109/tpwrs.2018.2807738>.
- 1139 [37] O. HUBER AND M. C. FERRIS, *Reformulations for convex composite functions and their nested*  
 1140 *compositions*, tech. report, University of Wisconsin, 2024.
- 1141

- 1142 [38] S. INIYAN, L. SUGANTHI, AND A. A. SAMUEL, *Energy models for commercial energy prediction*  
 1143 *and substitution of renewable energy sources*, Energy Policy, 34 (2006), pp. 2640–2653,  
 1144 <https://doi.org/10.1016/j.enpol.2004.11.017>.
- 1145 [39] J. IRIA AND F. SOARES, *An energy-as-a-service business model for aggregators of prosumers*,  
 1146 Applied Energy, 347 (2023), p. 121487, <https://doi.org/10.1016/j.apenergy.2023.121487>.
- 1147 [40] G. JAMES, D. WITTEN, T. HASTIE, AND R. T. HIRANI, *An Introduction to Statistical Learning*,  
 1148 Springer New York, 2013, <https://doi.org/10.1007/978-1-4614-7138-7>.
- 1149 [41] S. JEBARAJ AND S. INIYAN, *A review of energy models*, Renewable and Sustainable Energy  
 1150 Reviews, 10 (2006), pp. 281–311, <https://doi.org/10.1016/j.rser.2004.09.004>.
- 1151 [42] W. JEON, A. LAMADRID, AND T. MOUNT, *The economic value of distributed storage at different*  
 1152 *locations on an electric grid*, The Energy Journal, 40 (2019).
- 1153 [43] J. JOHNSTON, *Problems of equity and efficiency in the design of international greenhouse gas*  
 1154 *cap-and-trade schemes*, Harv. Envtl. L. Rev., 33 (2009), p. 405.
- 1155 [44] Y. KIM AND M. C. FERRIS, *Solving equilibrium problems using extended mathematical pro-*  
 1156 *gramming*, Mathematical Programming Computation, 11 (2019), pp. 457–501, <https://doi.org/10.1007/s12532-019-00156-4>.
- 1158 [45] Y. KIM, O. HUBER, AND M. C. FERRIS, *A structure-preserving pivotal method for affine vari-*  
 1159 *ational inequalities*, Mathematical Programming Computation, 168 (2017), pp. 93–121,  
 1160 <https://doi.org/10.1007/s10107-017-1124-9>.
- 1161 [46] B. KOCUK, H. JEON, S. S. DEY, J. LINDEROTH, J. LUEDTKE, AND A. SUN, *A cycle-based*  
 1162 *formulation and valid inequalities for DC power transmission problems with switching*,  
 1163 Operations Research, 64 (2016), pp. 928–938.
- 1164 [47] C. KOK, A. PHILPOTT, AND G. ZAKERI, *Value of transmission capacity in electricity markets with risk averse agents*, Tech. Report  
 1165 [www.epoc.org.nz/papers/TransmissionPaperOperationsResearch.pdf](http://www.epoc.org.nz/papers/TransmissionPaperOperationsResearch.pdf), EPOC Work-  
 1166 *ing Paper*, 2018.
- 1168 [48] C. LI, A. CONEJO, P. LIU, B. OMELL, J. SHIROLA, AND I. GROSSMANN, *Mixed-integer linear*  
 1169 *programming models and algorithms for generation and transmission expansion planning*  
 1170 *of power systems*, European Journal of Operational Research, 297 (2022), pp. 1071–1082.
- 1171 [49] H. MARKOWITZ, *Portfolio selection*, The Journal of Finance, 7 (1952), pp. 77–91.
- 1172 [50] J.-F. MERCURE, S. SHARPE, J. VINALES, M. IVES, M. GRUBB, A. LAM, P. DRUMMOND,  
 1173 H. POLLITT, F. KNOBLOCH, AND F. J. NIJSSE, *Risk-opportunity analysis for transformative*  
 1174 *policy design and appraisal*, Global Environmental Change, 70 (2021), p. 102359.
- 1175 [51] P. MOUTIS AND O. ALIZADEH-MOUSAVI, *Digital twin of distribution power transformer for real-*  
 1176 *time monitoring of medium voltage from low voltage measurements*, IEEE Transactions on  
 1177 Power Delivery, 36 (2021), pp. 1952–1963, <https://doi.org/10.1109/tpwrd.2020.3017355>.
- 1178 [52] F. MURPHY, A. PIERRU, AND Y. SMEERS, *Measuring the effects of price controls using mixed*  
 1179 *complementarity models*, European Journal of Operational Research, 275 (2019), pp. 666–  
 1180 676, <https://doi.org/10.1016/j.ejor.2018.11.051>.
- 1181 [53] I. K. NTI, M. TEIMEH, O. NYARKO-BOATENG, AND A. F. ADEKOYA, *Electricity load forecasting:*  
 1182 *a systematic review*, Journal of Electrical Systems and Information Technology, 7 (2020),  
 1183 <https://doi.org/10.1186/s43067-020-00021-8>.
- 1184 [54] Ö. OKUR, P. HEIJNEN, AND Z. LUKSZO, *Aggregator’s business models in residential and service*  
 1185 *sectors: A review of operational and financial aspects*, Renewable and Sustainable Energy  
 1186 Reviews, 139 (2021), p. 110702, <https://doi.org/10.1016/j.rser.2020.110702>.
- 1187 [55] A. PFENNINGER, S. AND HAWKES AND J. KEIRSTEAD, *Energy systems modeling for twenty-first*  
 1188 *century energy challenges*, Renewable and Sustainable Energy Reviews, 33 (2014), pp. 74–  
 1189 86.
- 1190 [56] A. B. PHILPOTT, M. C. FERRIS, AND R. J. B. WETS, *Equilibrium, uncertainty and risk in*  
 1191 *hydro-thermal electricity systems*, Mathematical Programming B, 157 (2016), pp. 483–513,  
 1192 <https://doi.org/10.1007/s10107-015-0972-4>.
- 1193 [57] W. POWELL, *A unified framework for stochastic optimization*, European Journal of Operational  
 1194 Research, 275 (2019), pp. 795–821.
- 1195 [58] W. B. POWELL, *Approximate Dynamic Programming: Solving the Curses of Dimensionality*,  
 1196 Wiley, Aug. 2011, <https://doi.org/10.1002/9781118029176>.
- 1197 [59] D. POZO, *Linear battery models for power systems analysis*, Electric Power Systems Research,  
 1198 212 (2022), p. 108565, <https://doi.org/10.1016/j.epsr.2022.108565>.
- 1199 [60] D. POZO, E. SAUMA, AND J. CONTRERAS, *A three-level static MILP model for generation*  
 1200 *and transmission expansion planning*, IEEE Transactions on Power systems, 28 (2012),  
 1201 pp. 202–210.
- 1202 [61] D. RALPH AND Y. SMEERS, *Risk trading and endogenous probabilities in investment equilibria*,  
 1203 SIAM Journal on Optimization, 25 (2015), pp. 2589–2611.

- 1204 [62] R. ROSSMANN, M. ANITESCU, J. BESSAC, M. FERRIS, M. KROCK, J. LUEDTKE, AND L. ROALD,  
1205 *A framework for balancing power grid resiliency and efficiency with bi-objective stochastic*  
1206 *integer optimization*, tech. report, University of Wisconsin, 2024.
- 1207 [63] N. SEPULVEDA, J. JENKINS, A. EDINGTON, D. MALLAPRAGADA, AND R. LESTER, *The design*  
1208 *space for long-duration energy storage in decarbonized power systems*, Nature Energy, 6  
1209 (2021), pp. 506–516.
- 1210 [64] A. SHAPIRO, D. DENTCHEVA, AND A. RUSZCZYNSKI, *Lectures on stochastic programming: mod-*  
1211 *eling and theory*, SIAM, 2021.
- 1212 [65] J. SHEN, *Theory and Computation of the Multistage Stochastic Equilibria with Risk-Averse*  
1213 *Players*, PhD thesis, University of Wisconsin –Madison, 2023.
- 1214 [66] K. SINGH, A. PHILPOTT, AND K. WOOD, *Column generation for design of survivable networks*,  
1215 tech. report, Electric Power Optimization Centre, 2006, [https://www.epoc.org.nz/papers/](https://www.epoc.org.nz/papers/SinghPhilpottWood.pdf)  
1216 [SinghPhilpottWood.pdf](https://www.epoc.org.nz/papers/SinghPhilpottWood.pdf).
- 1217 [67] R. SIOSHANSI, P. DENHOLM, T. JENKIN, AND J. WEISS, *Estimating the value of electricity*  
1218 *storage in PJM: Arbitrage and some welfare effects*, Energy Economics, 31 (2009), pp. 269–  
1219 277.
- 1220 [68] S. STOFT, *Power System Economics*, IEEE Press, Piscataway, 2002.
- 1221 [69] B. STOTT, J. JARDIM, AND O. ALSAC, *DC power flow revisited*, IEEE Transactions on Power  
1222 Systems, 24 (2009), pp. 1290–1300, <https://doi.org/10.1109/tpwrs.2009.2021235>, [http://](http://ieeexplore.ieee.org/xpls/abs/all.jsp?arnumber=4956966)  
1223 [ieeexplore.ieee.org/xpls/abs/all.jsp?arnumber=4956966](http://ieeexplore.ieee.org/xpls/abs/all.jsp?arnumber=4956966).
- 1224 [70] S.-B. TSAI, Y. XUE, J. ZHANG, Q. CHEN, Y. LIU, J. ZHOU, AND W. DONG, *Models for fore-*  
1225 *casting growth trends in renewable energy*, Renewable and Sustainable Energy Reviews, 77  
1226 (2017), pp. 1169–1178, <https://doi.org/10.1016/j.rser.2016.06.001>.
- 1227 [71] W. TUSHAR, T. K. SAHA, C. YUEN, AND D. S. A ND H. VINCENT POOR, *Peer-to-peer trading in*  
1228 *electricity networks: An overview*, IEEE Transactions on Smart Grid, 11 (2020), pp. 3185–  
1229 3200, <https://doi.org/10.1109/tsg.2020.2969657>.
- 1230 [72] J. VILLUMSEN, G. BRØNMO, AND A. PHILPOTT, *Line capacity expansion and transmission*  
1231 *switching in power systems with large-scale wind power*, IEEE Transactions on Power  
1232 Systems, 28 (2012), pp. 731–739.
- 1233 [73] P. WEBER AND M. WOERMAN, *Intermittency or uncertainty? Impacts of renewable energy*  
1234 *in electricity markets*, SSRN Electronic Journal, (2022), [https://doi.org/10.2139/ssrn.](https://doi.org/10.2139/ssrn.4212066)  
1235 [4212066](https://doi.org/10.2139/ssrn.4212066).
- 1236 [74] L. WEN, K. ZHOU, S. YANG, AND X. LU, *Optimal load dispatch of community microgrid with*  
1237 *deep learning based solar power and load forecasting*, Energy, 171 (2019), pp. 1053–1065,  
1238 <https://doi.org/10.1016/j.energy.2019.01.075>.
- 1239 [75] N. WINCHESTER AND D. WHITE, *The climate policy analysis (C-PLAN) model, version 1.0*,  
1240 Energy Economics, 108 (2022), p. 105896.
- 1241 [76] S. WOGGIN, D. TEJADA-ARANGO, A. DOWNWARD, AND A. PHILPOTT, *Welfare-maximizing*  
1242 *transmission capacity expansion under uncertainty*, Philosophical Transactions of the  
1243 Royal Society A, 379 (2021), p. 20190436.
- 1244 [77] X. XI, R. SIOSHANSI, AND V. MARANO, *A stochastic dynamic programming model for co-*  
1245 *optimization of distributed energy storage*, Energy Systems, 5 (2014), pp. 475–505.